





Appendix A – HV Feeder R1 (SMR8)


Single Day Analysis – Tailored Volt-Watt Volt-Var Settings

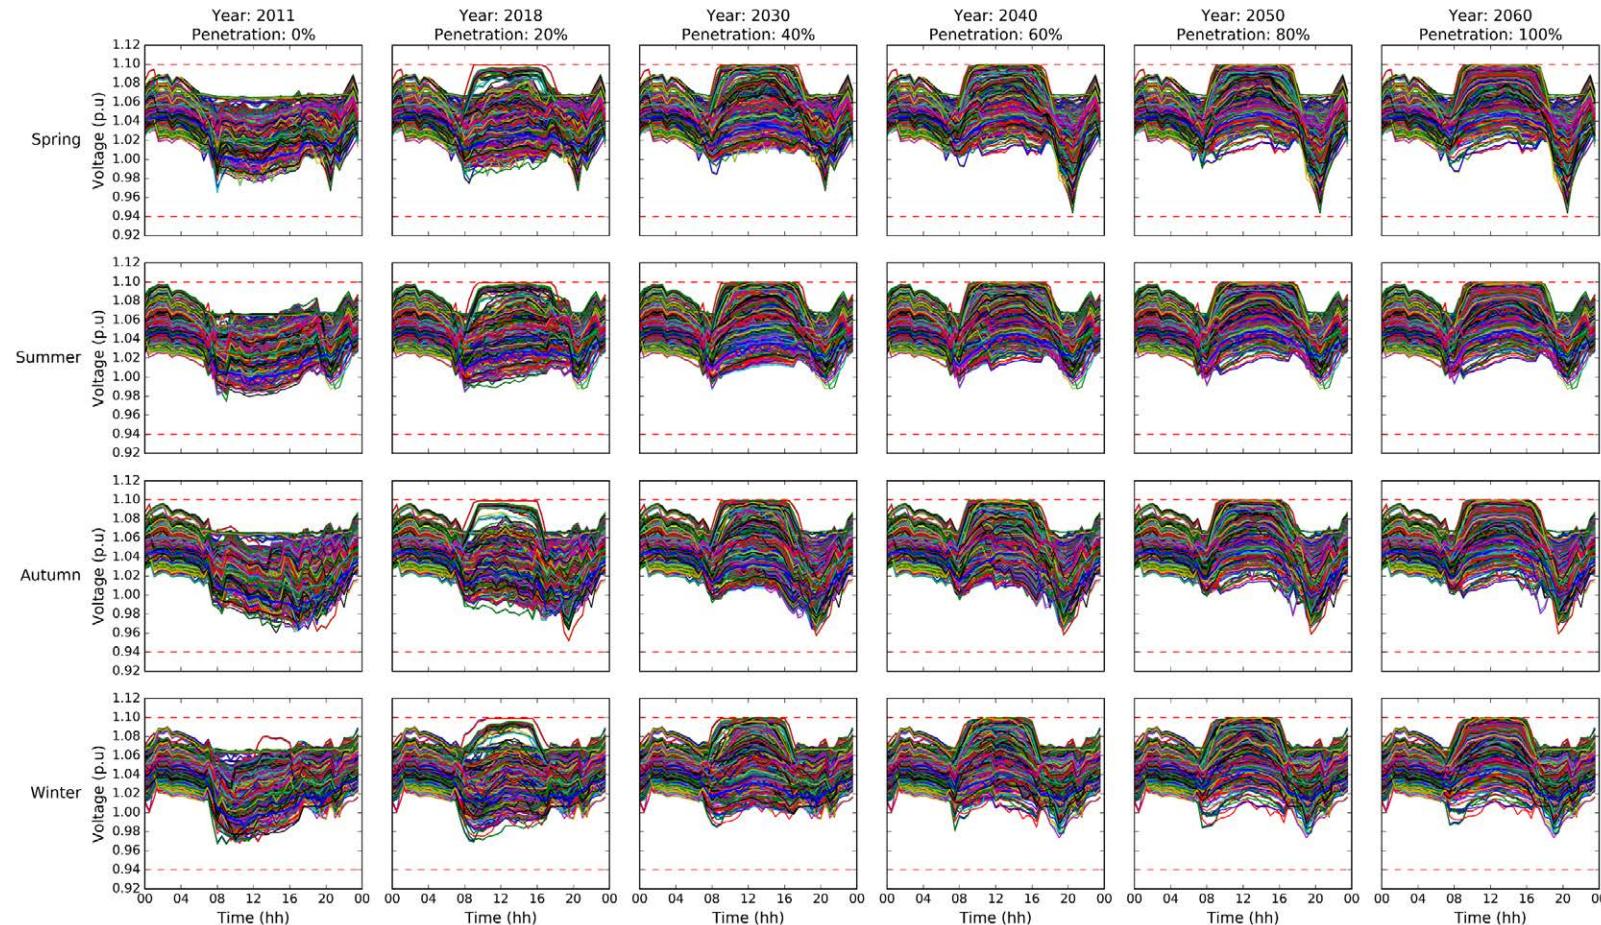


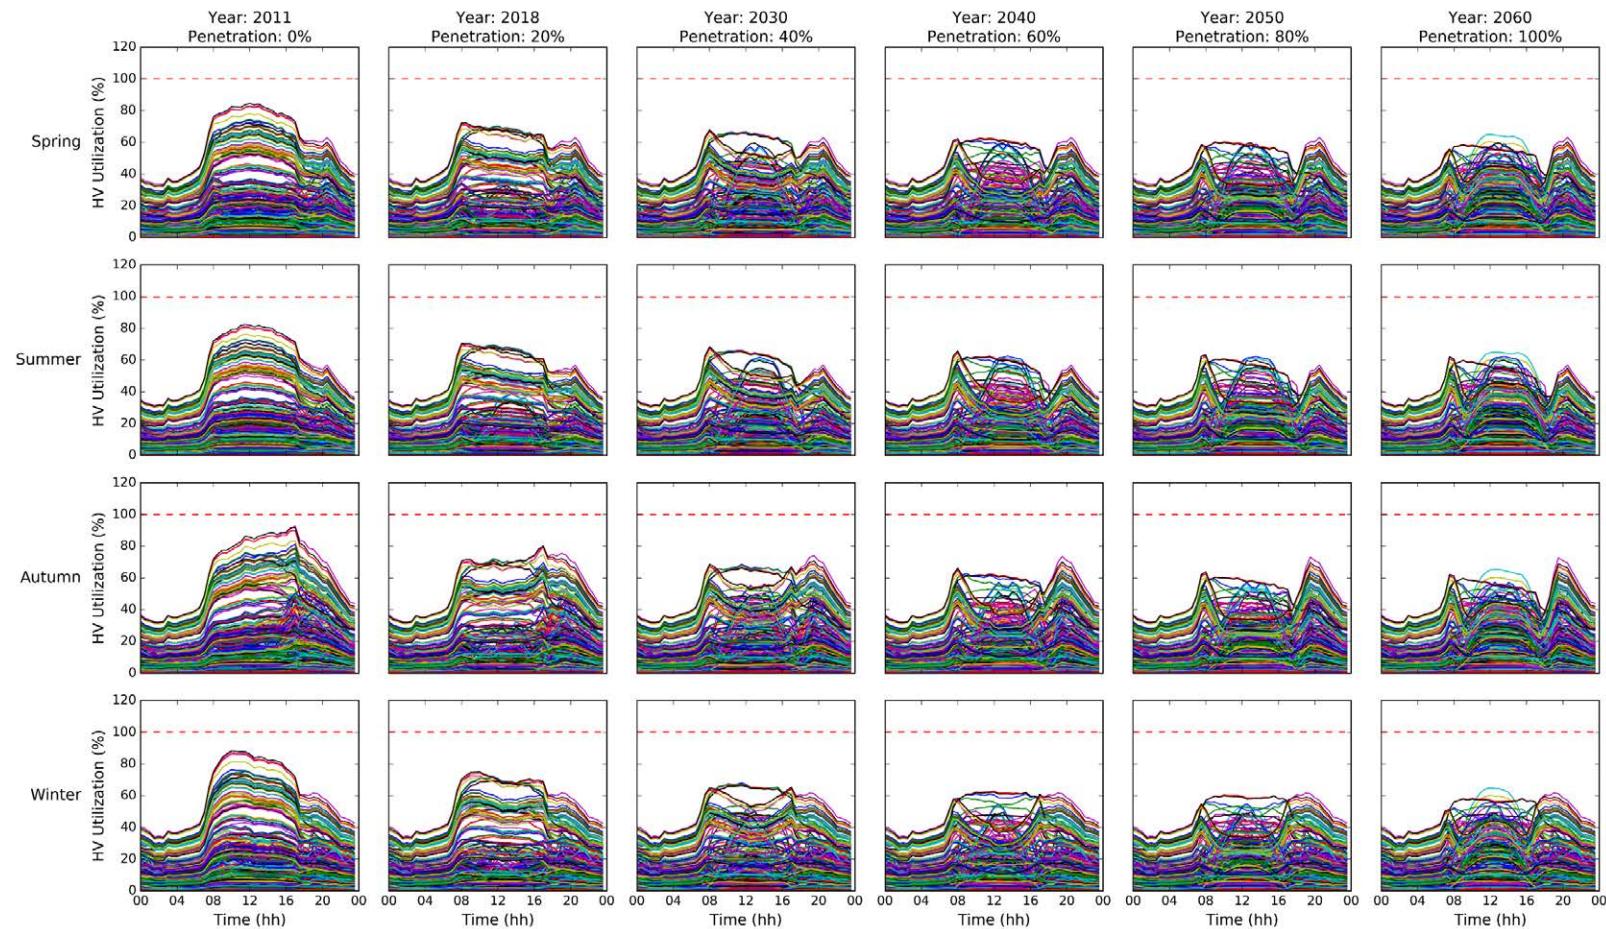

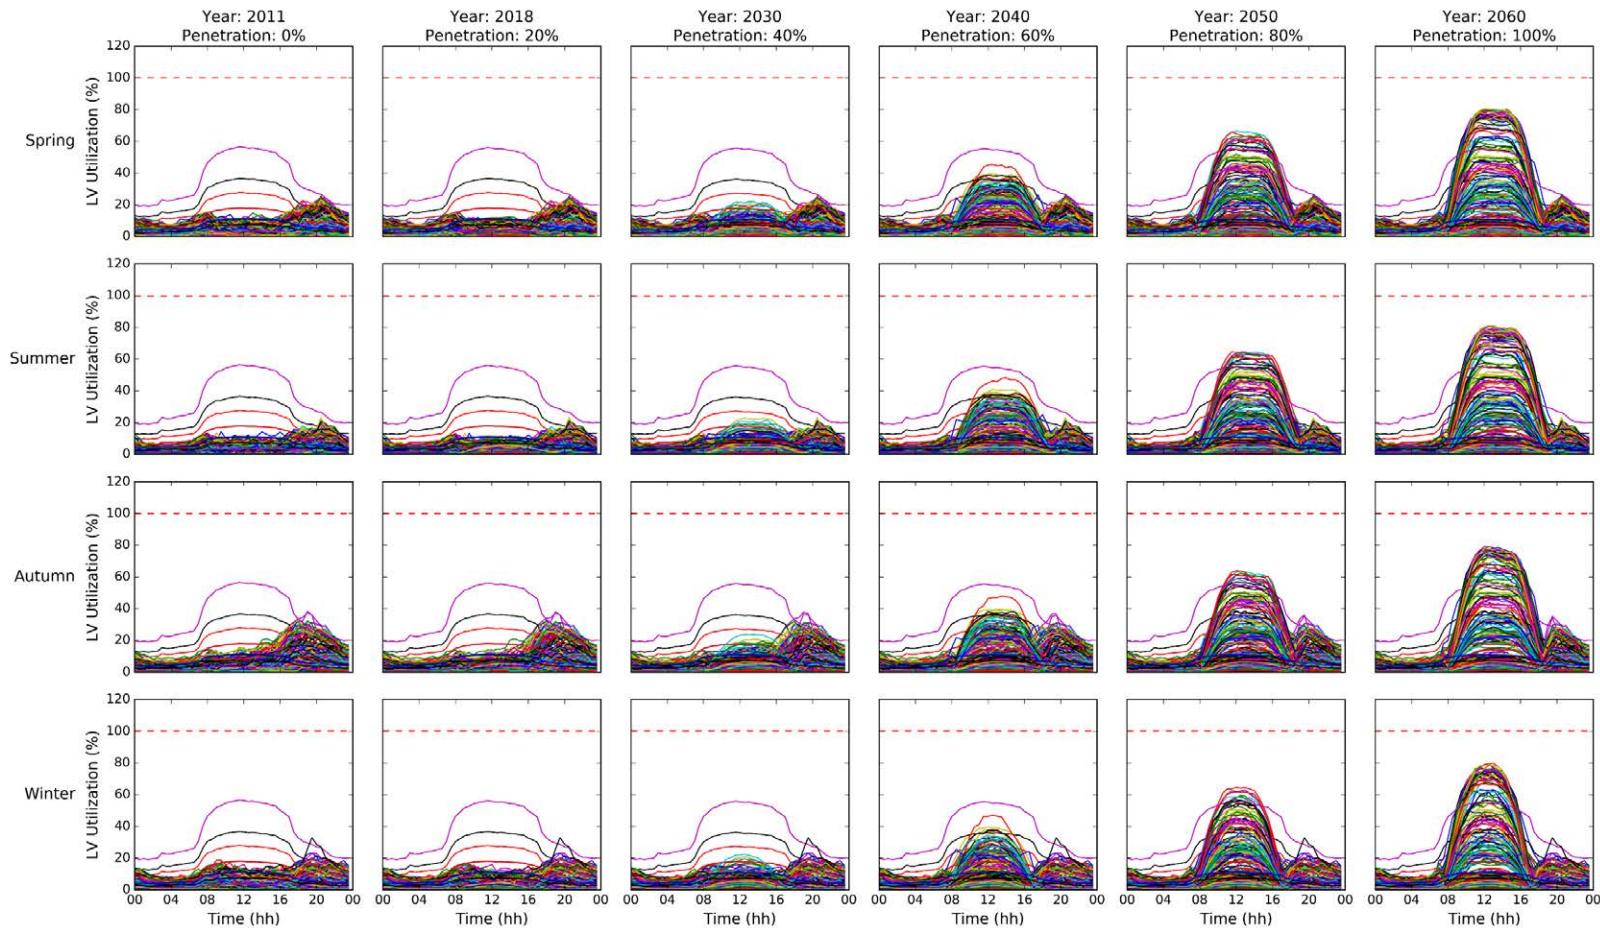


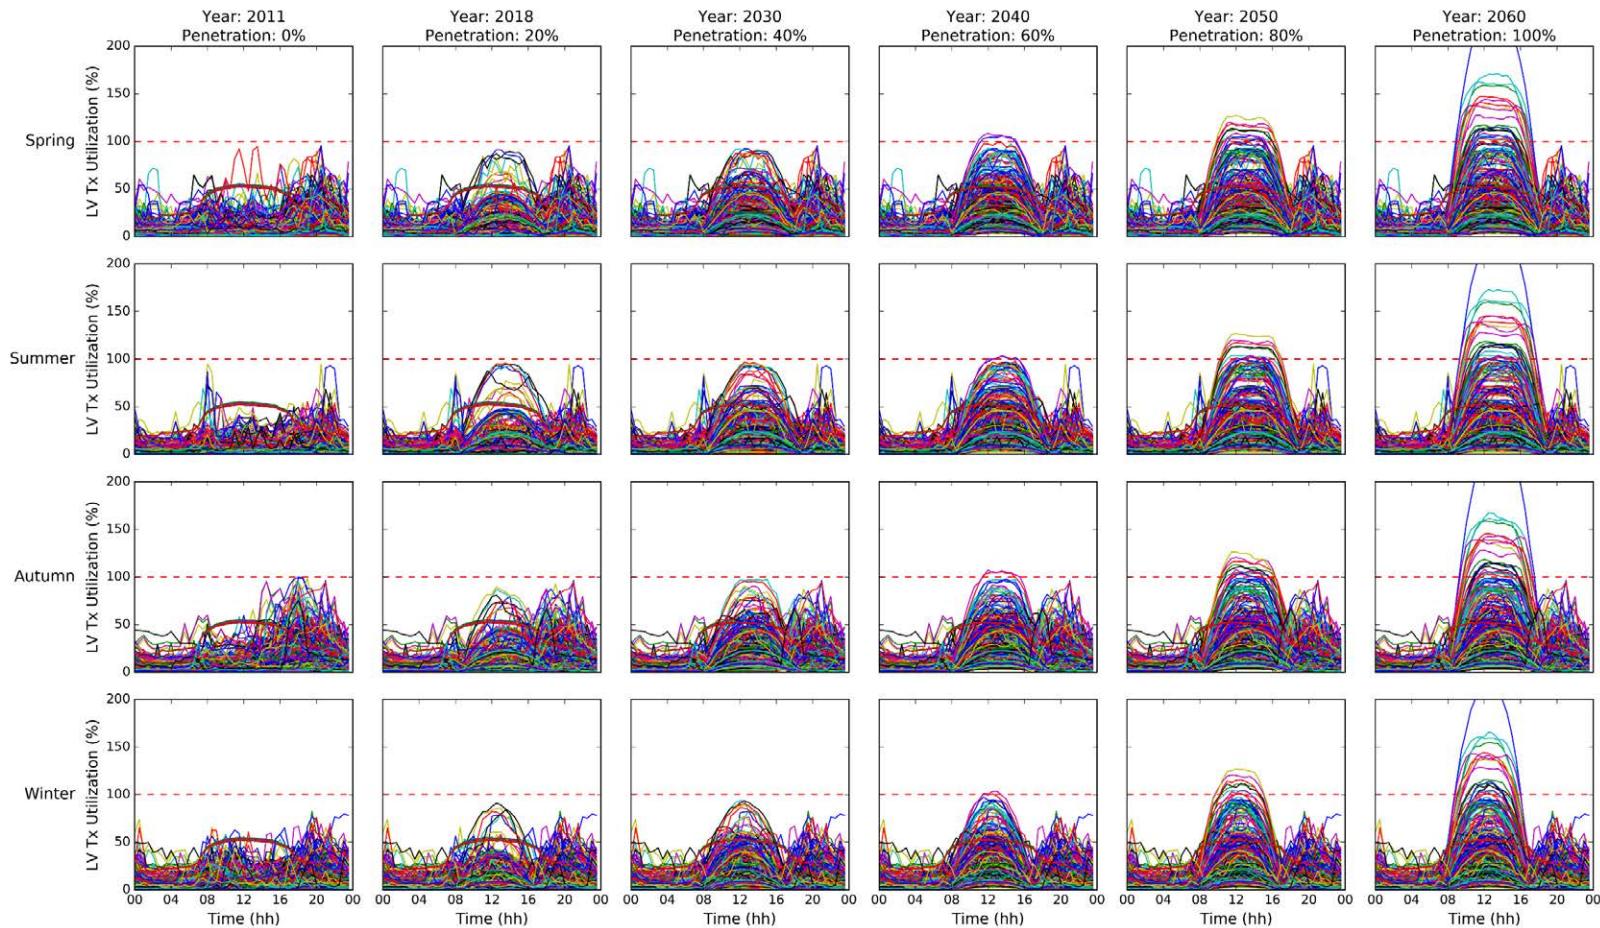


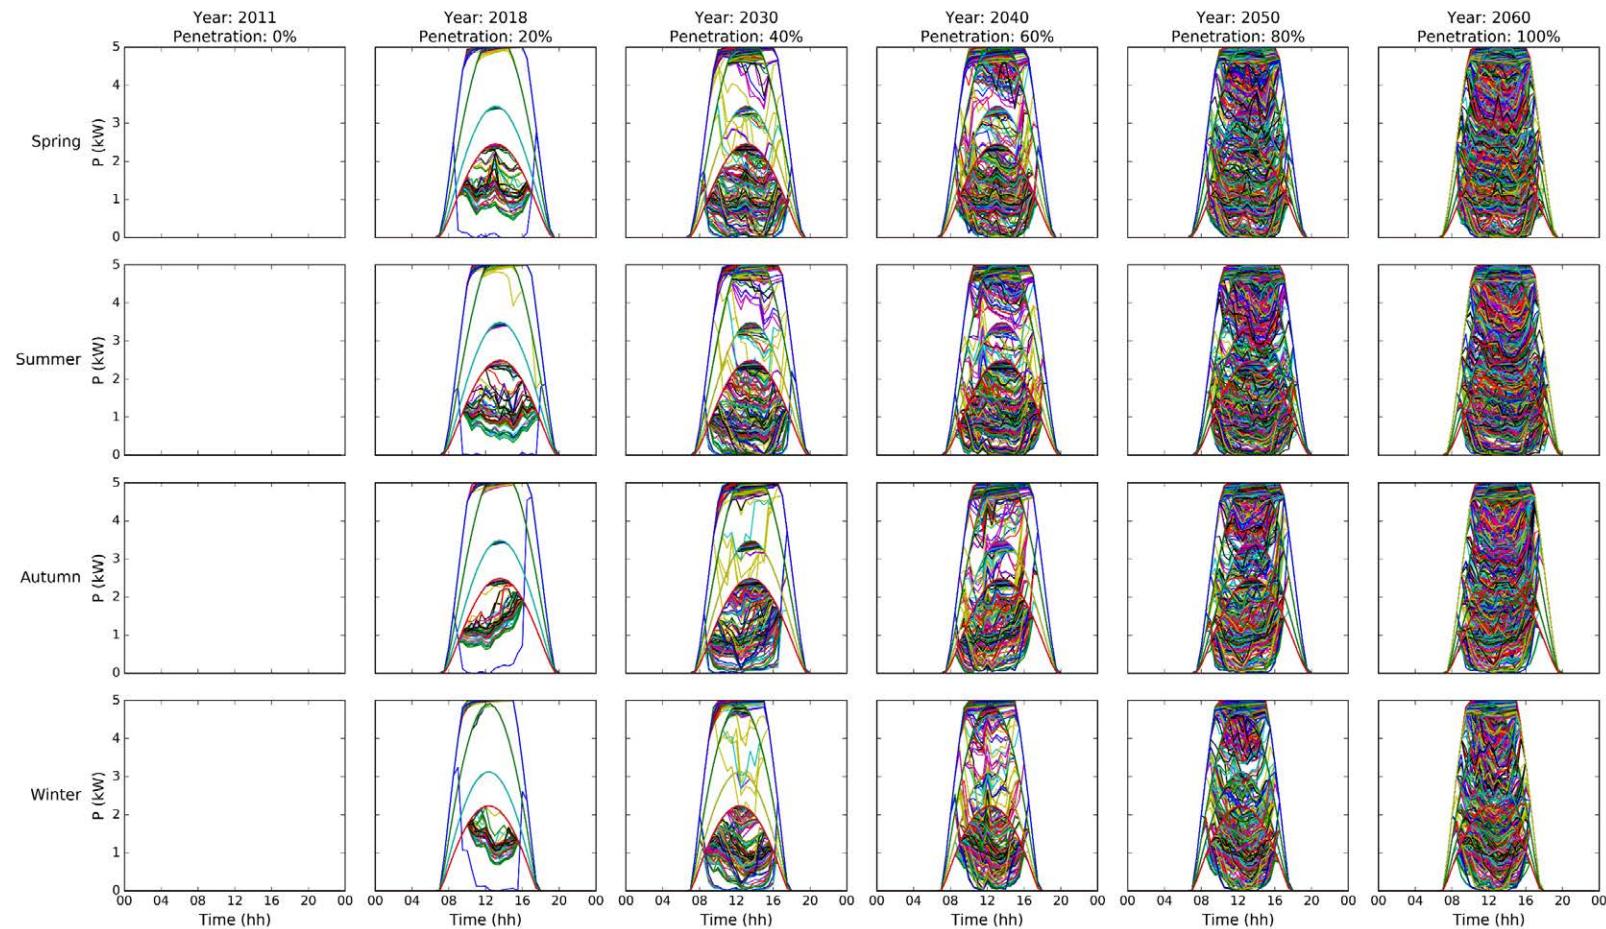


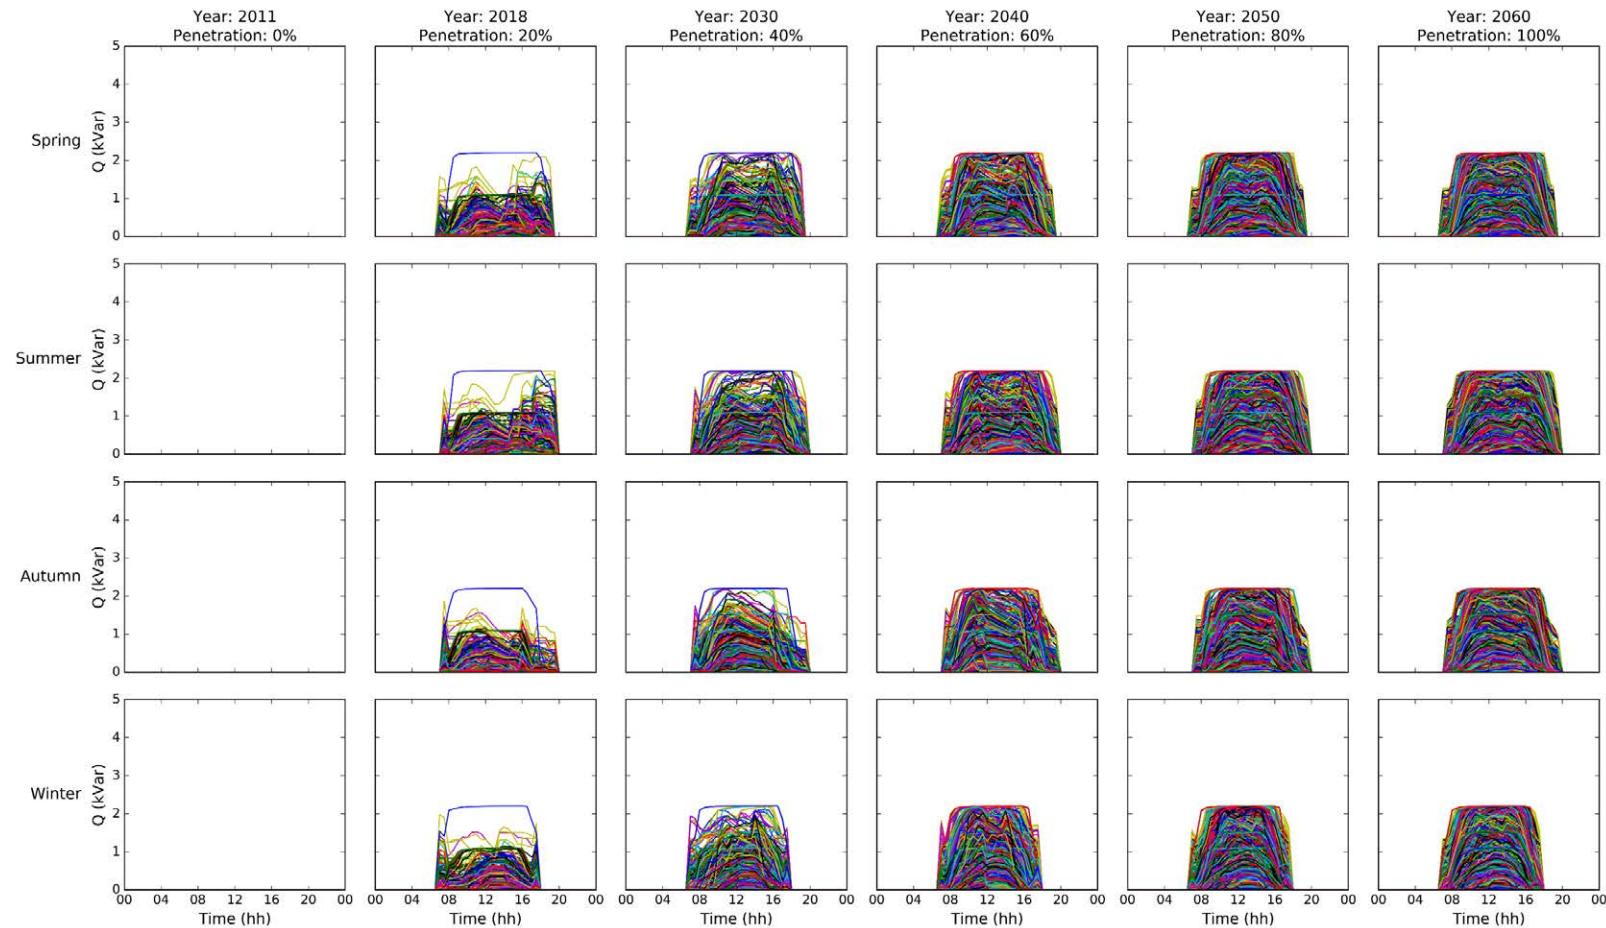



Single Day Analysis – LV OLTC-fitted Transformers

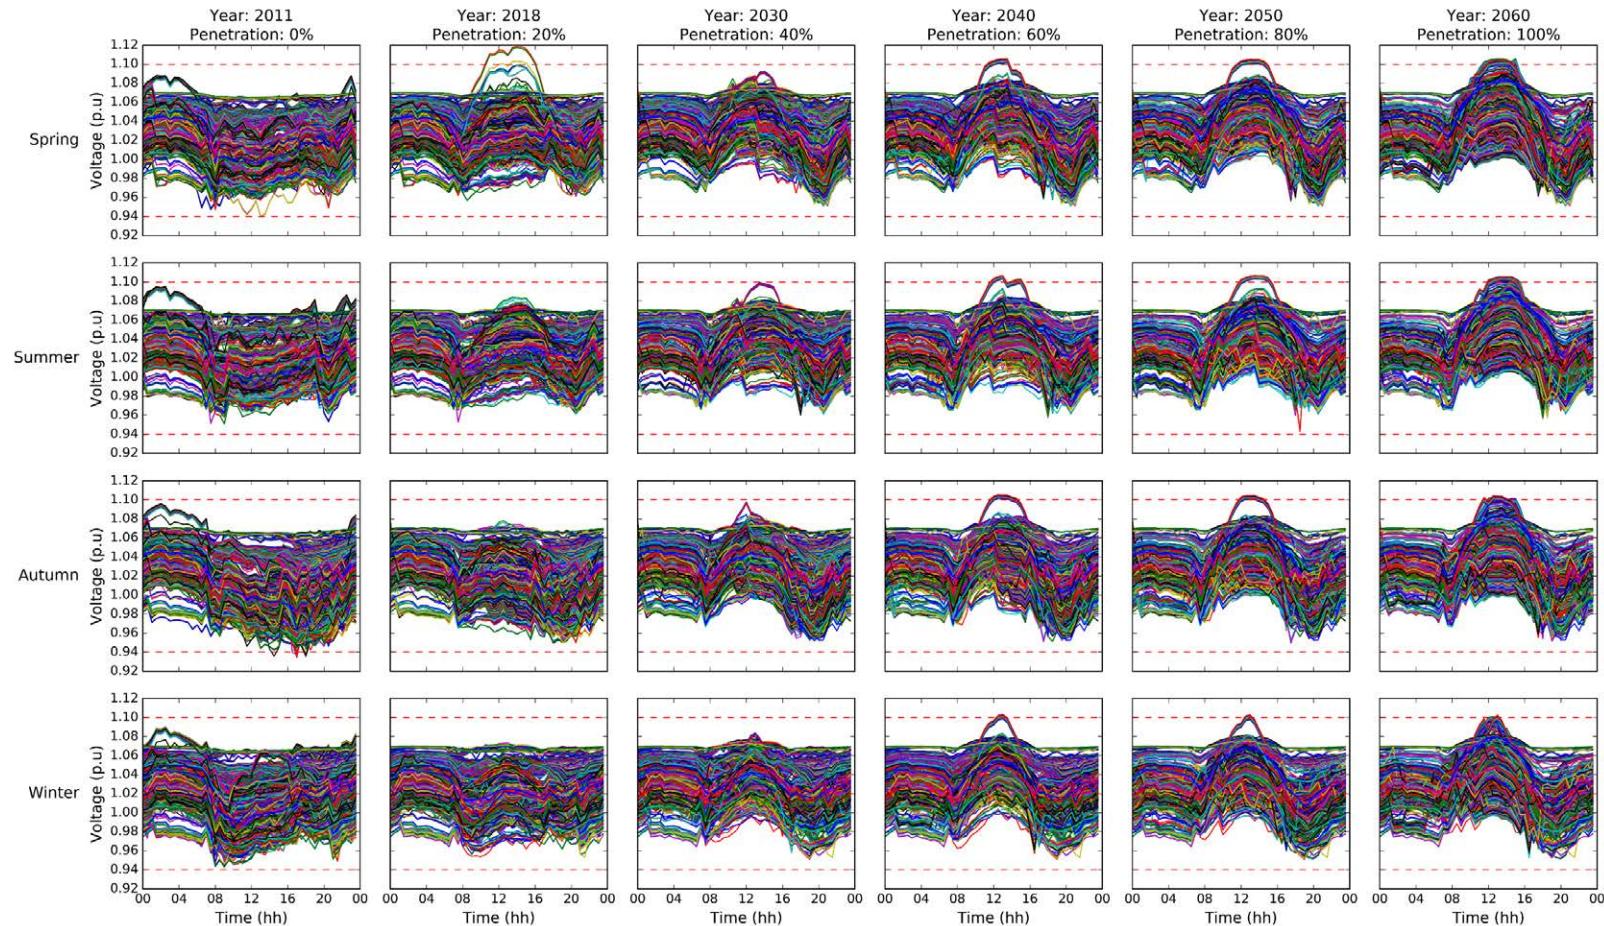


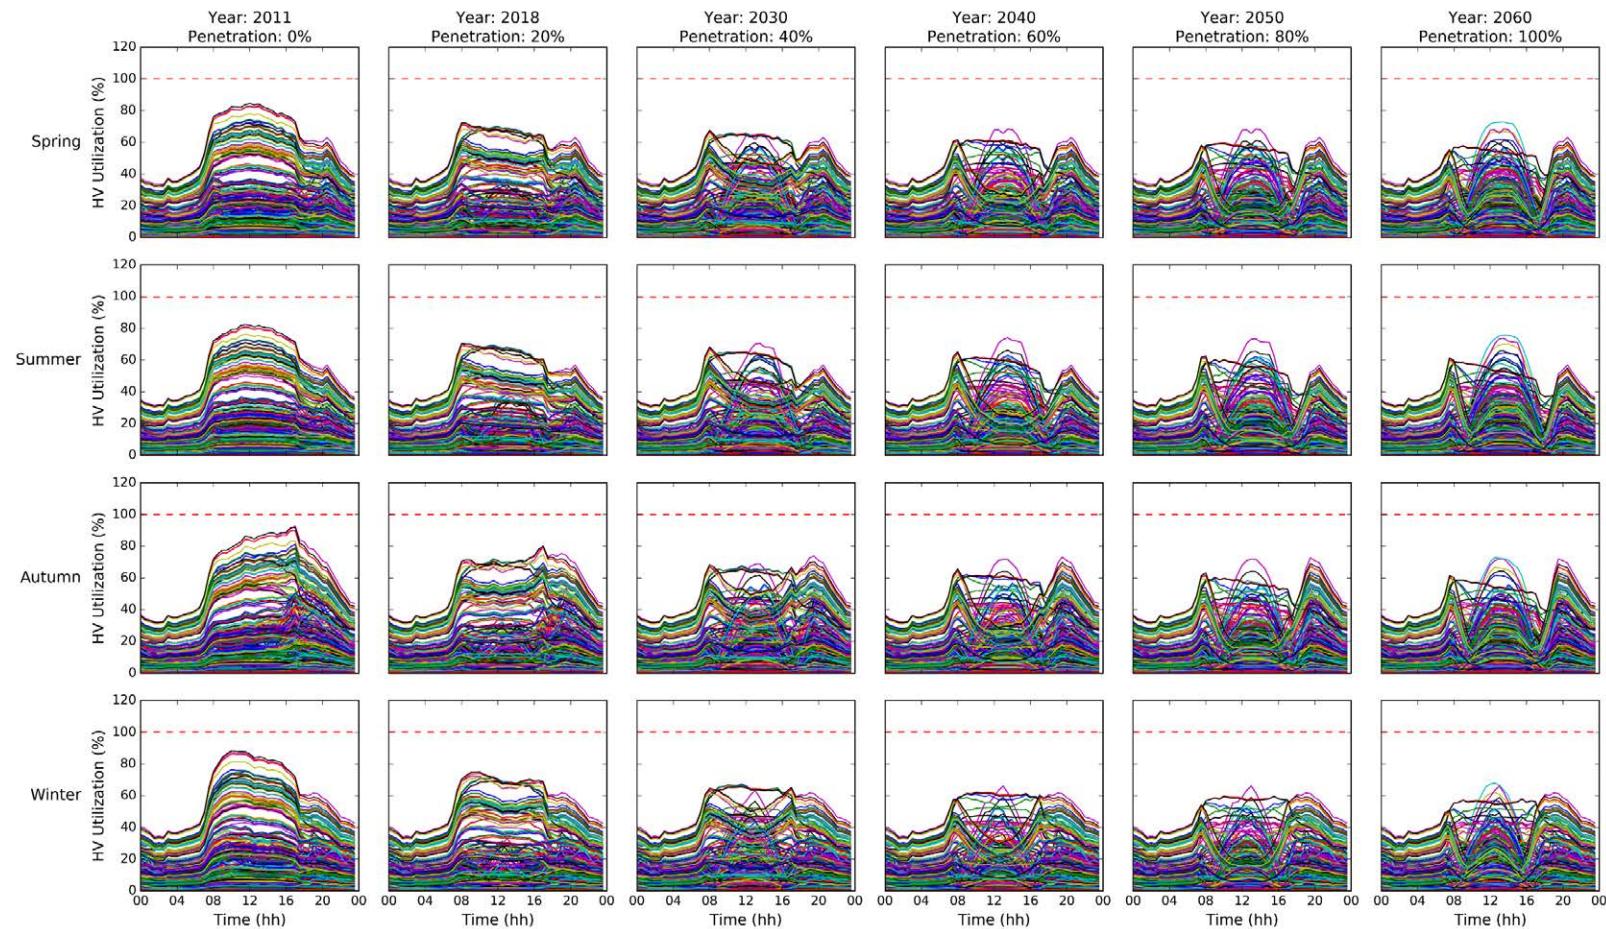


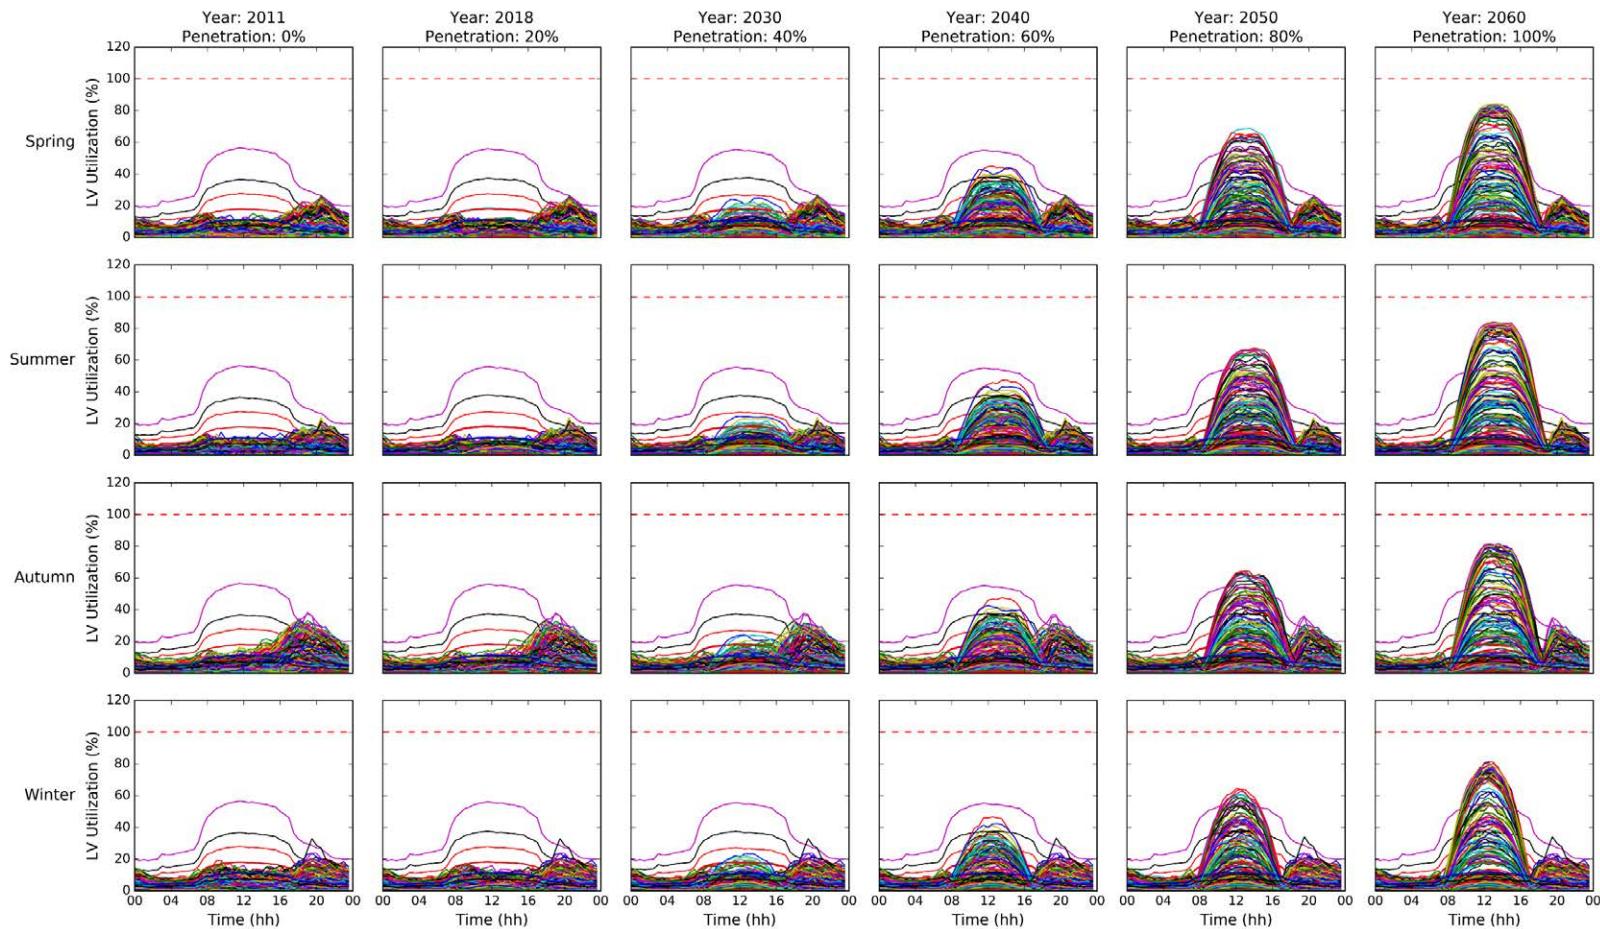

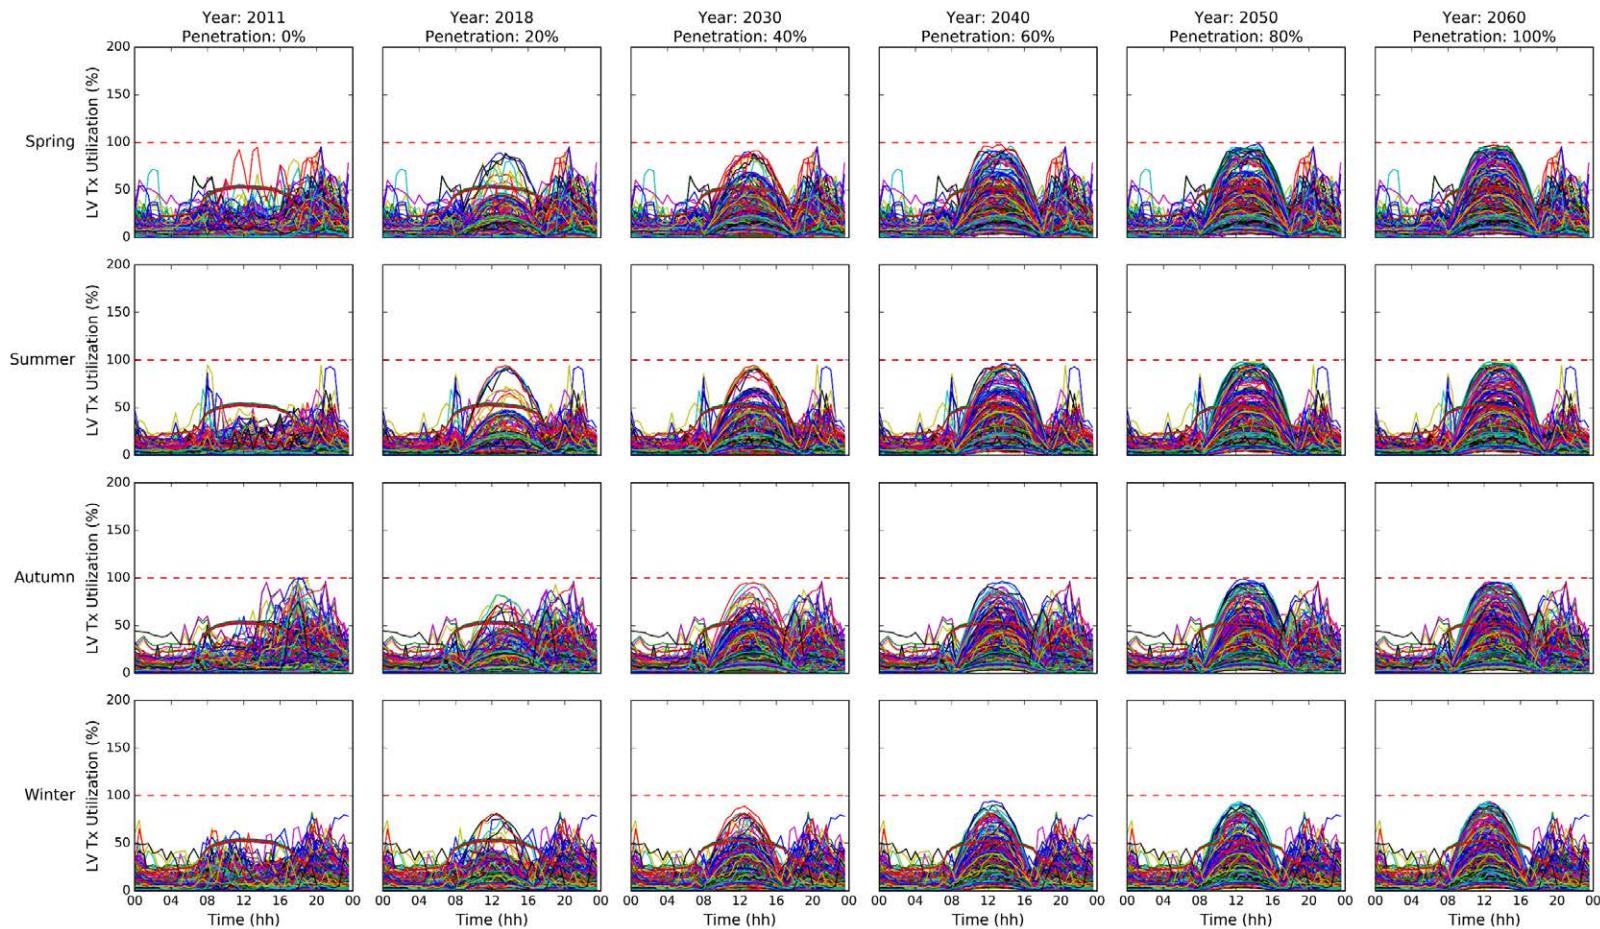


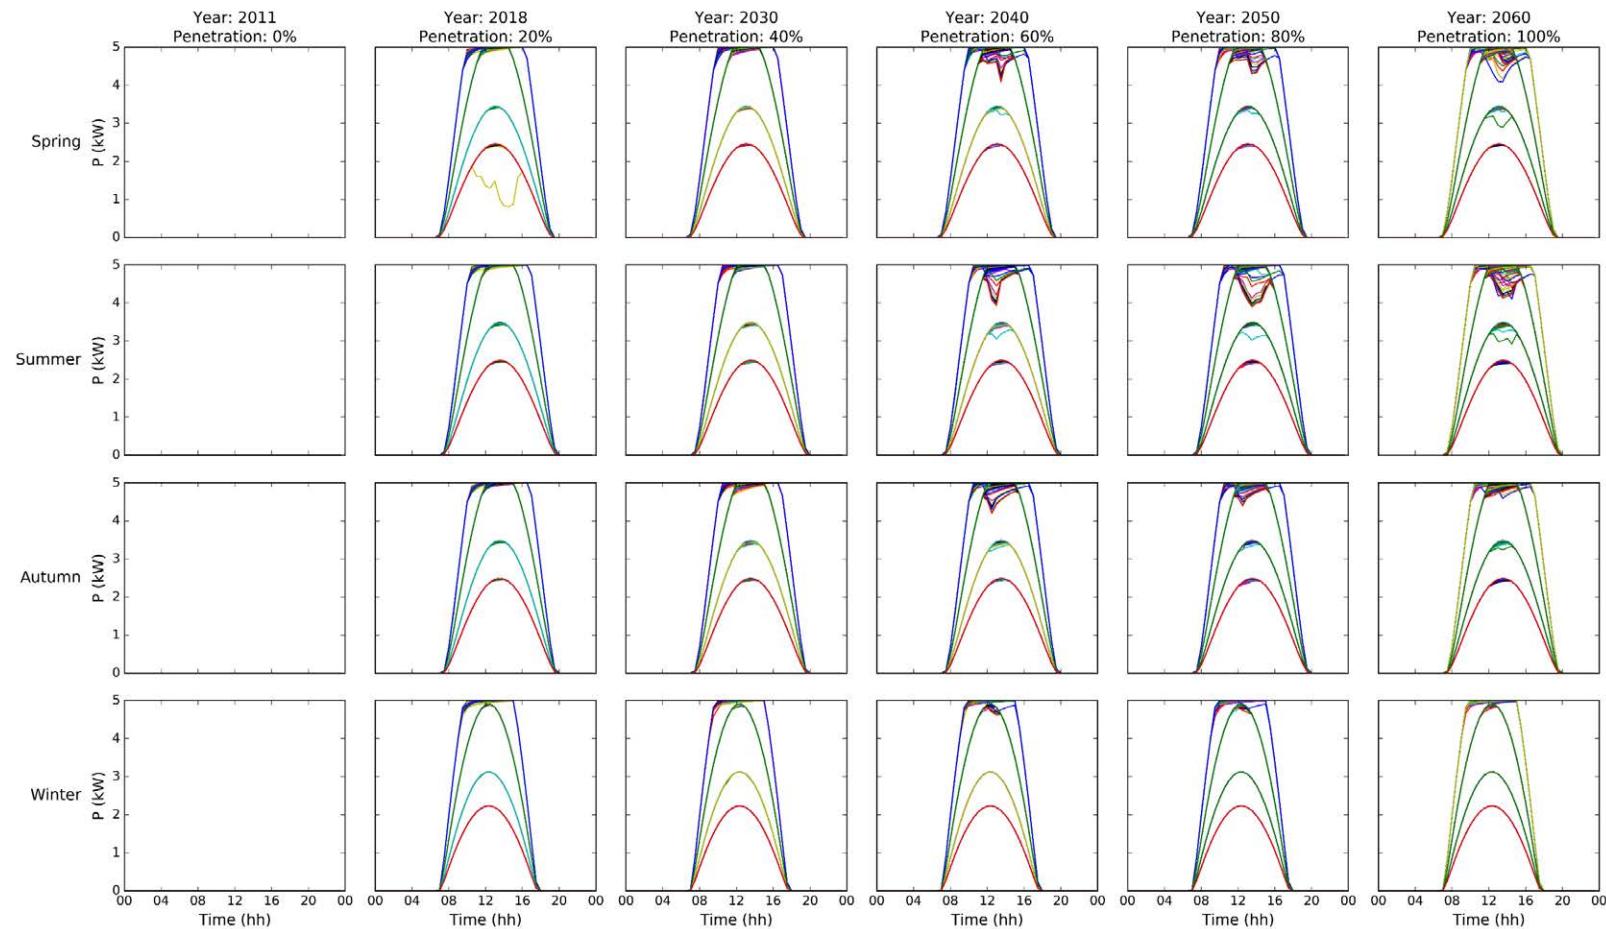


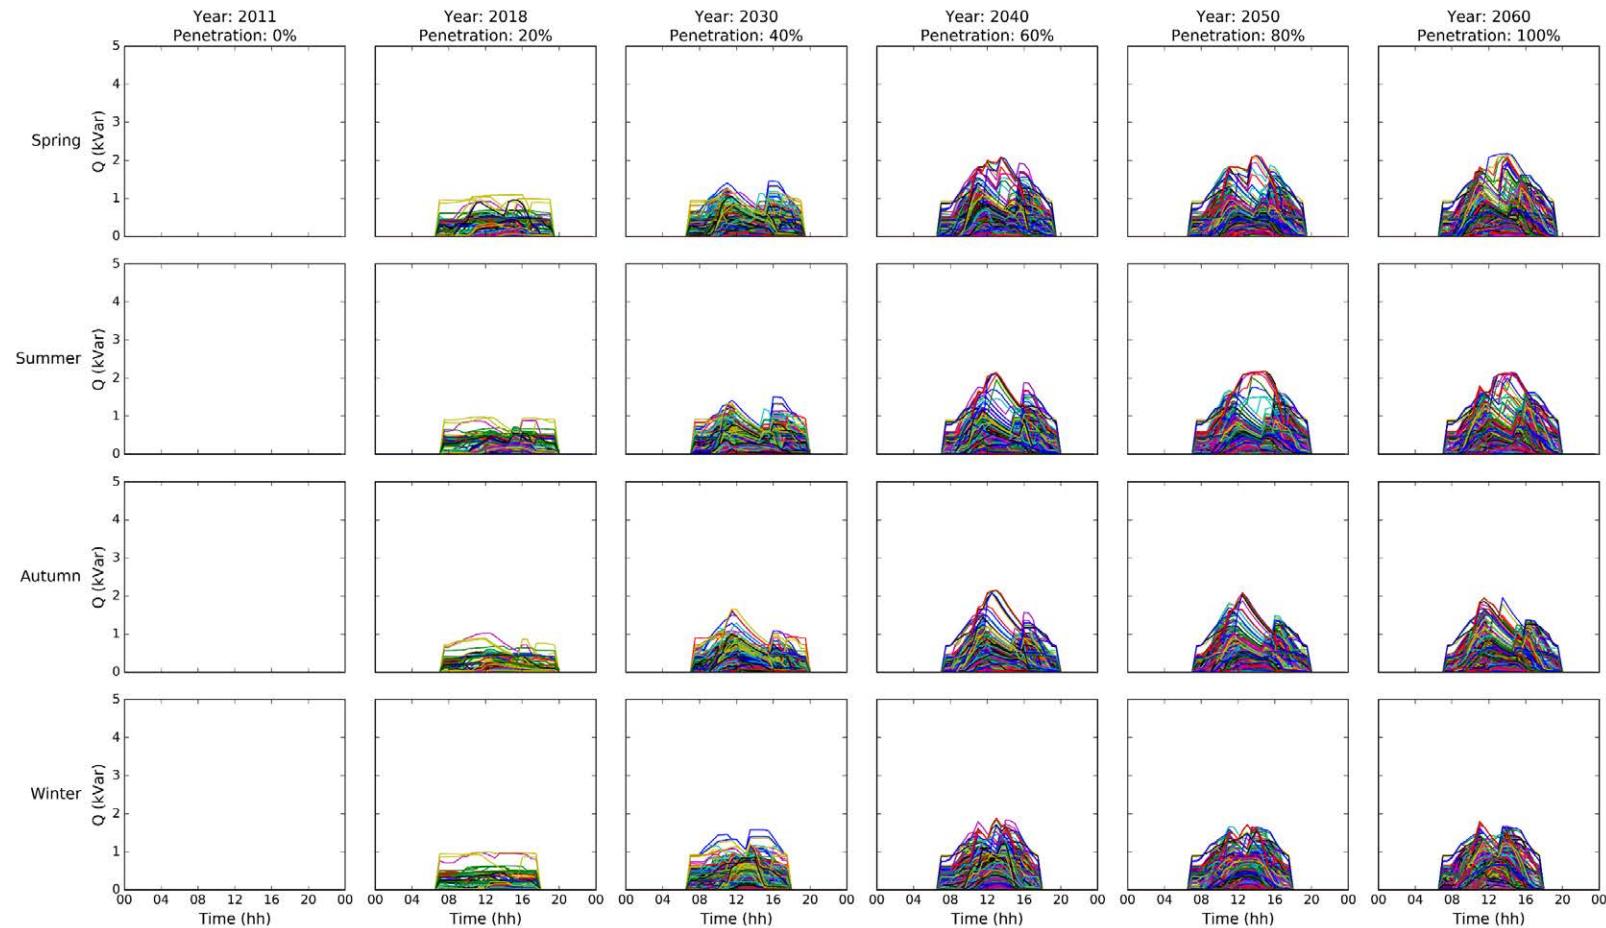


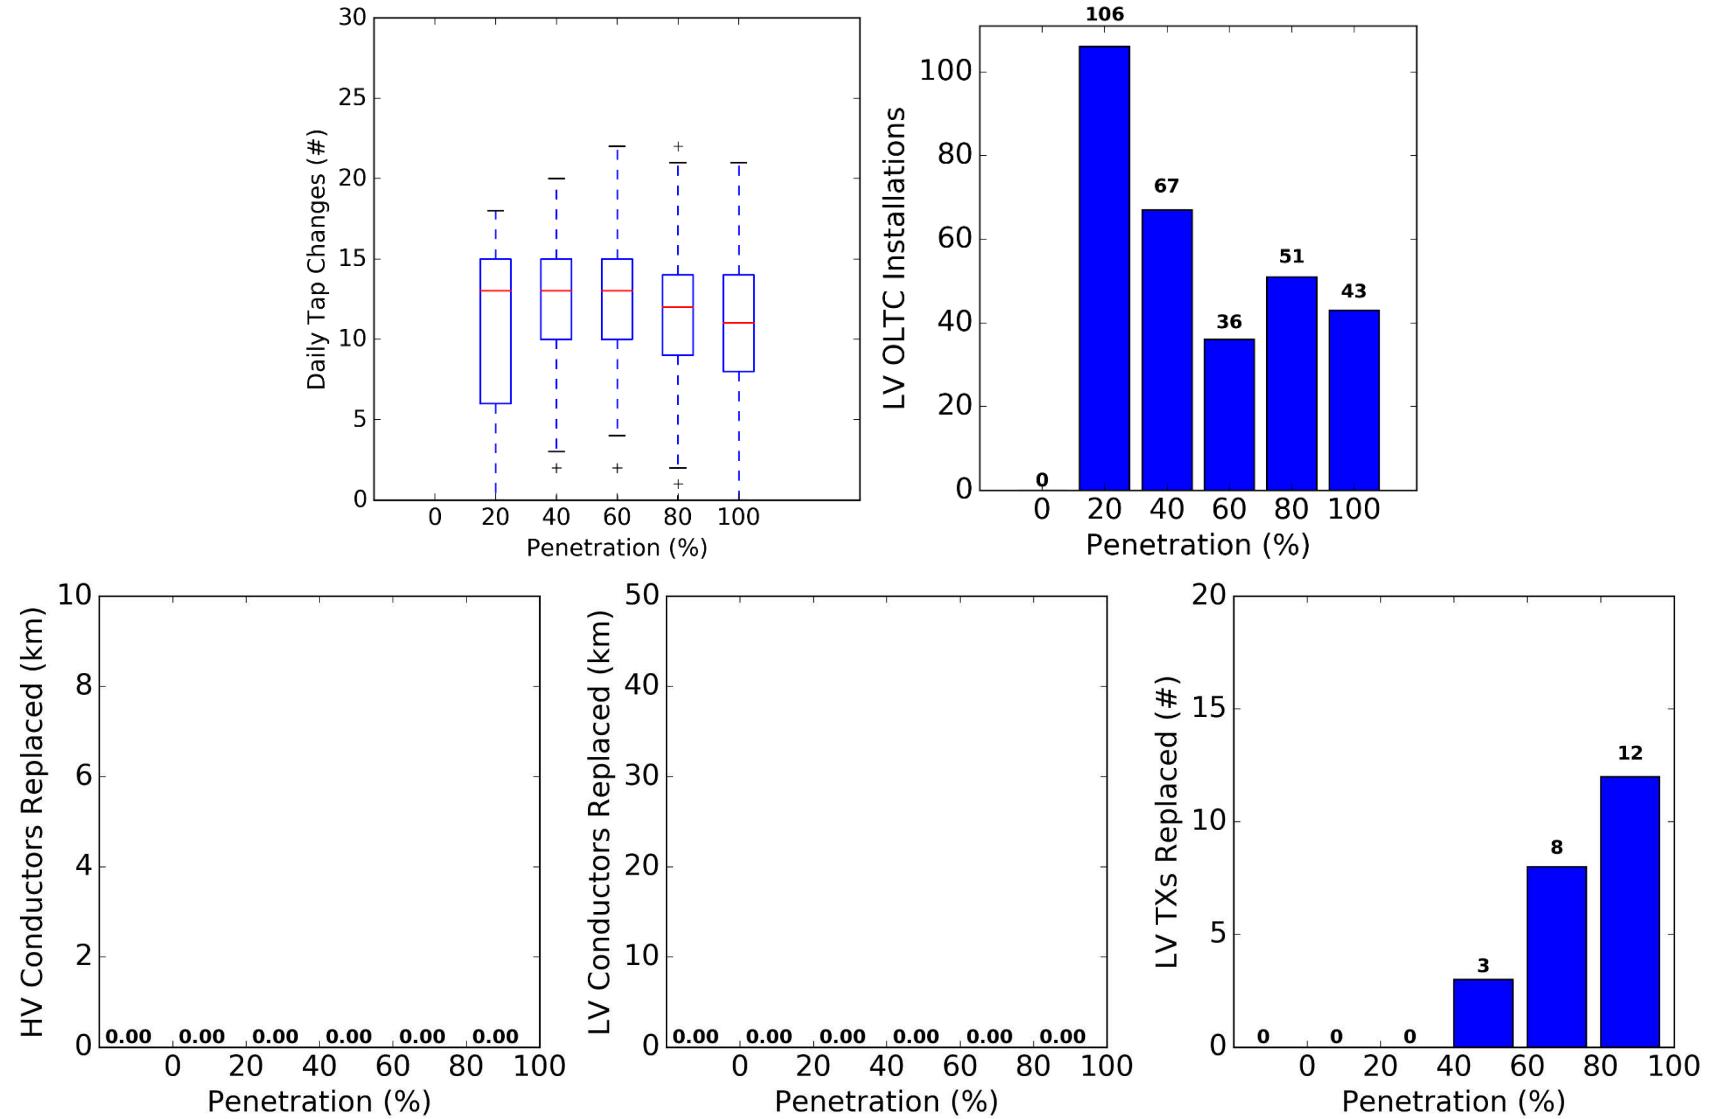



Single Day Analysis – Off-the-Shelf BES

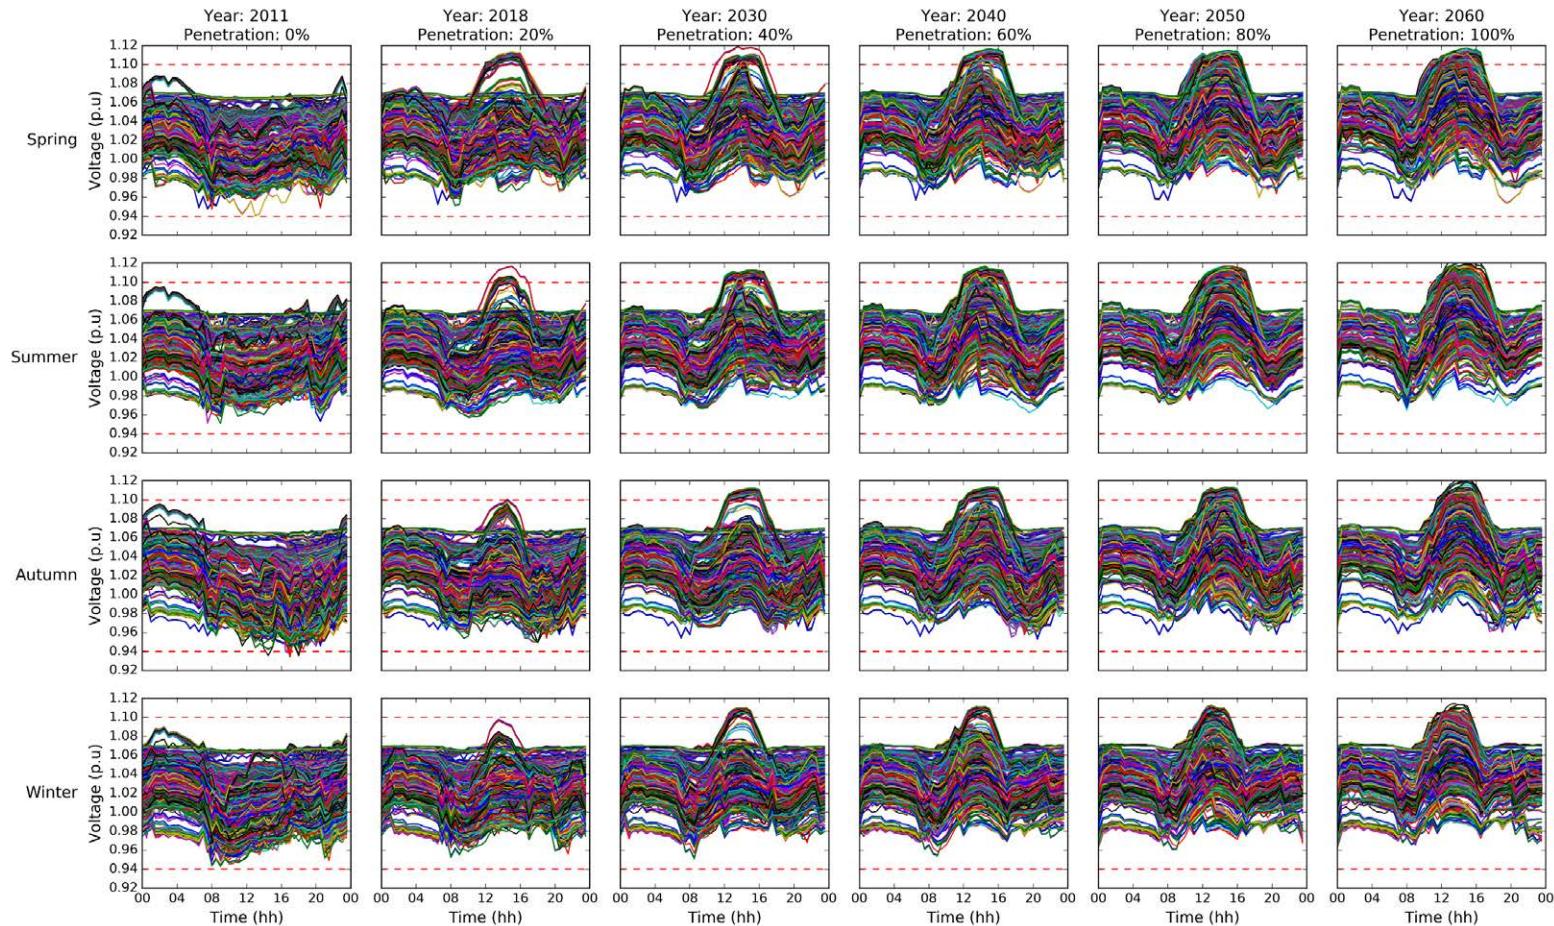





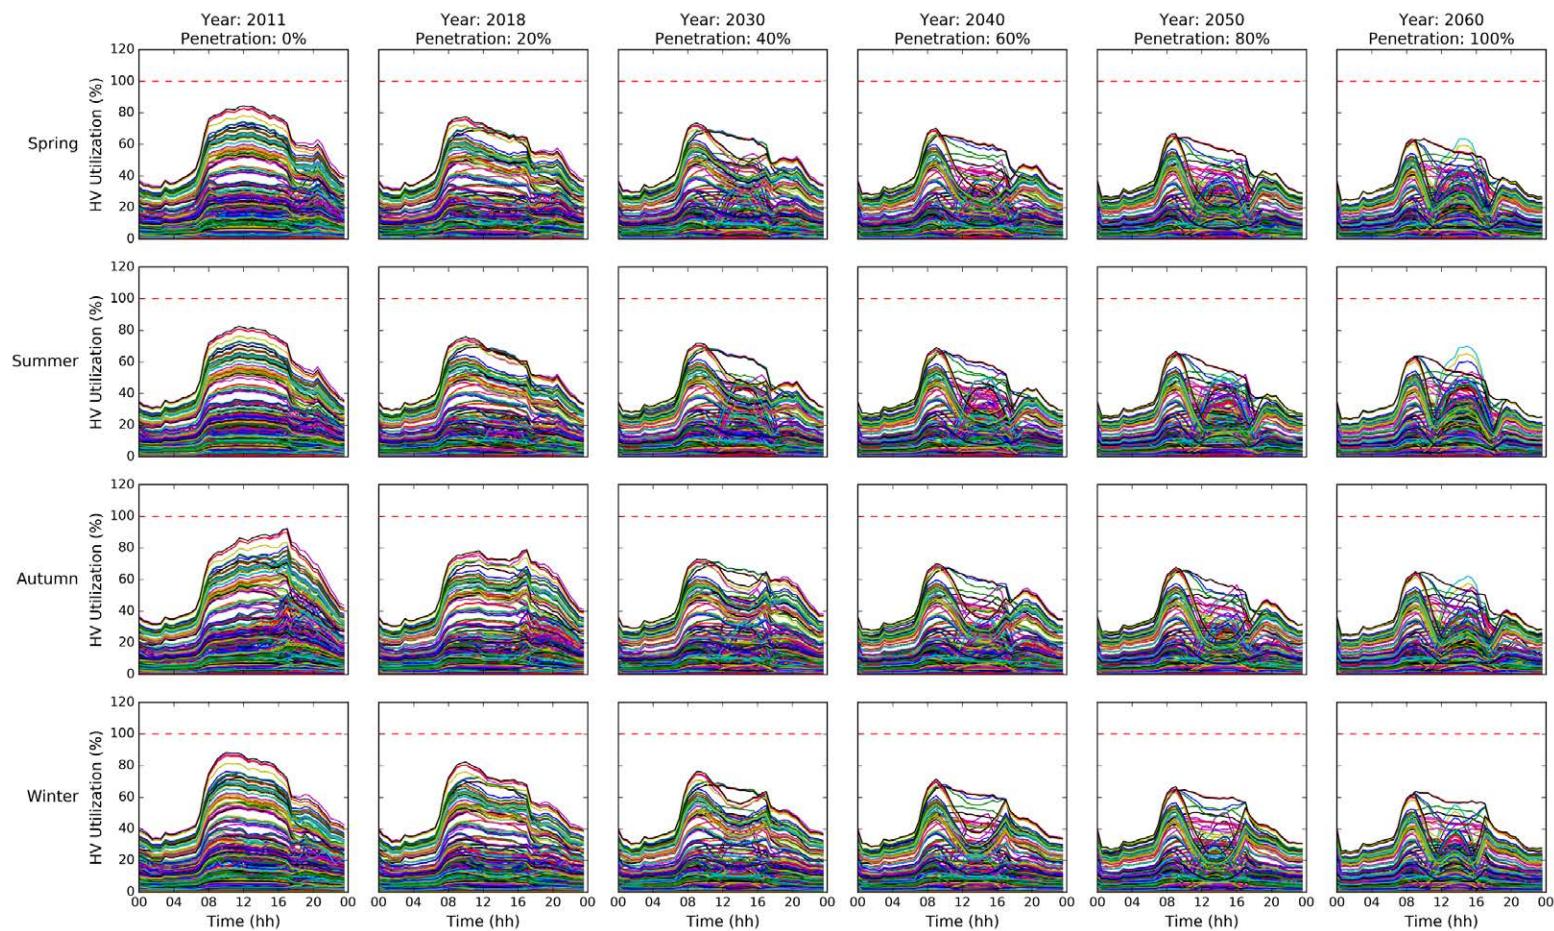


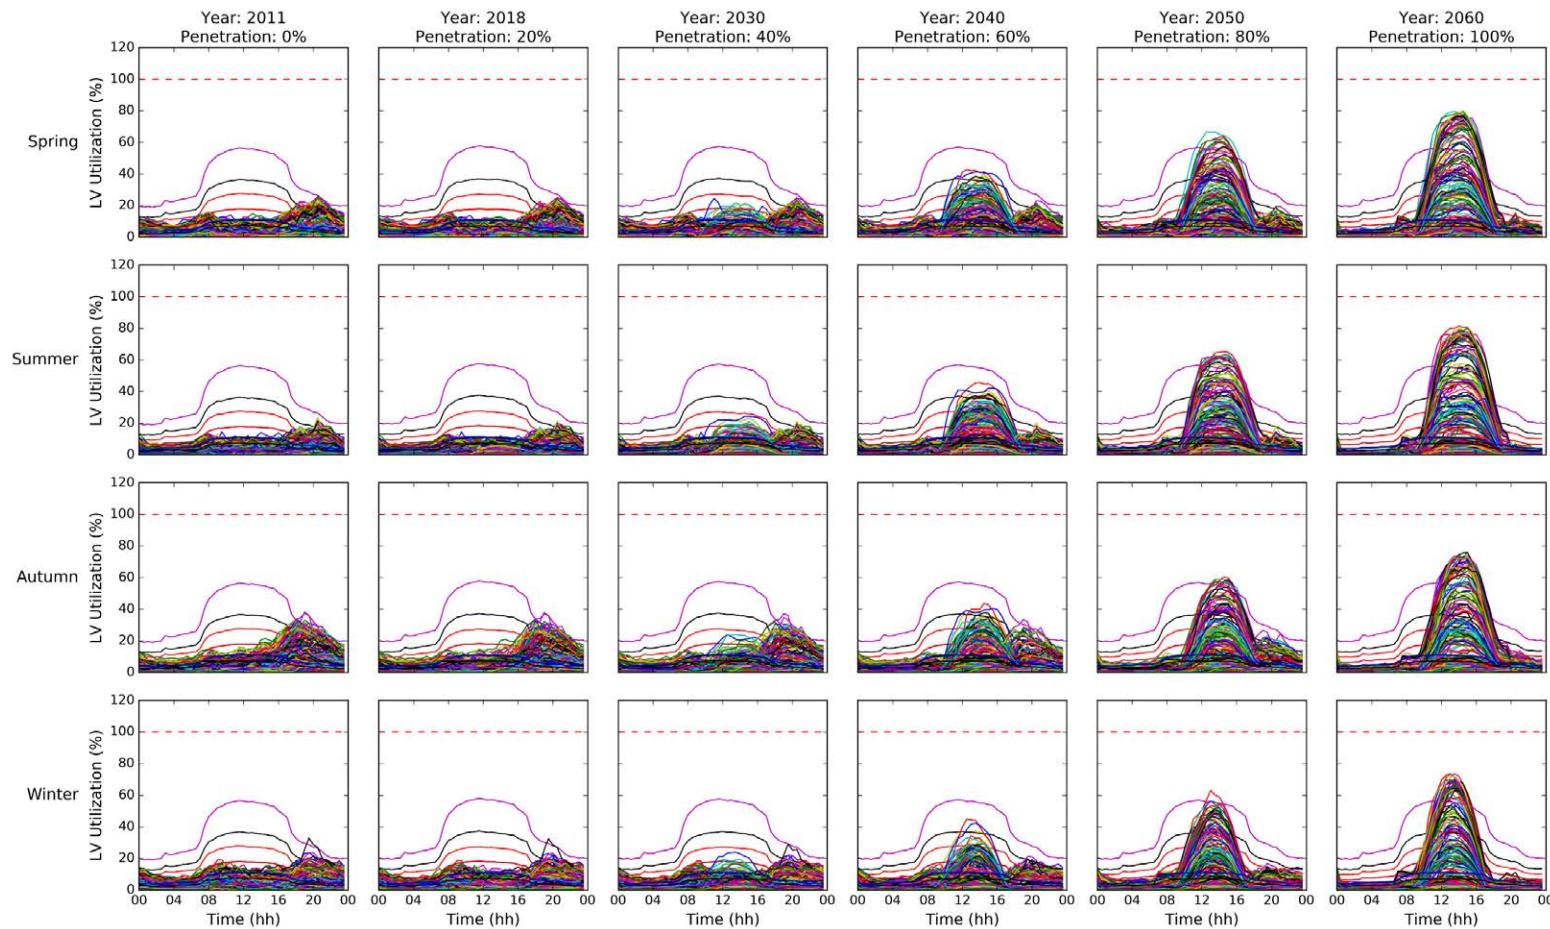

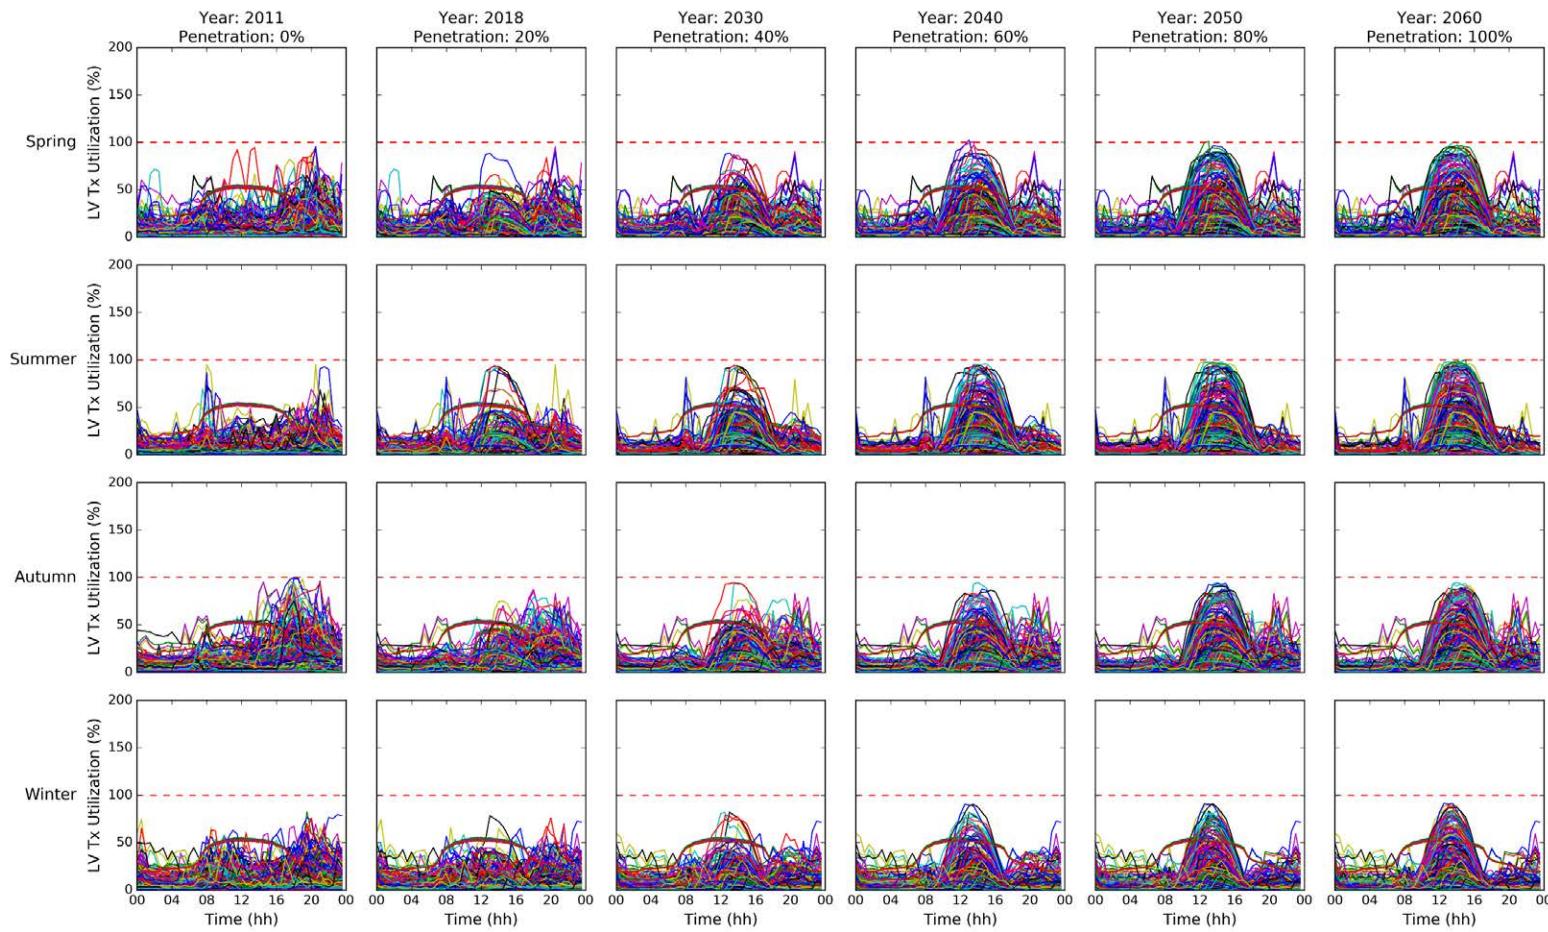


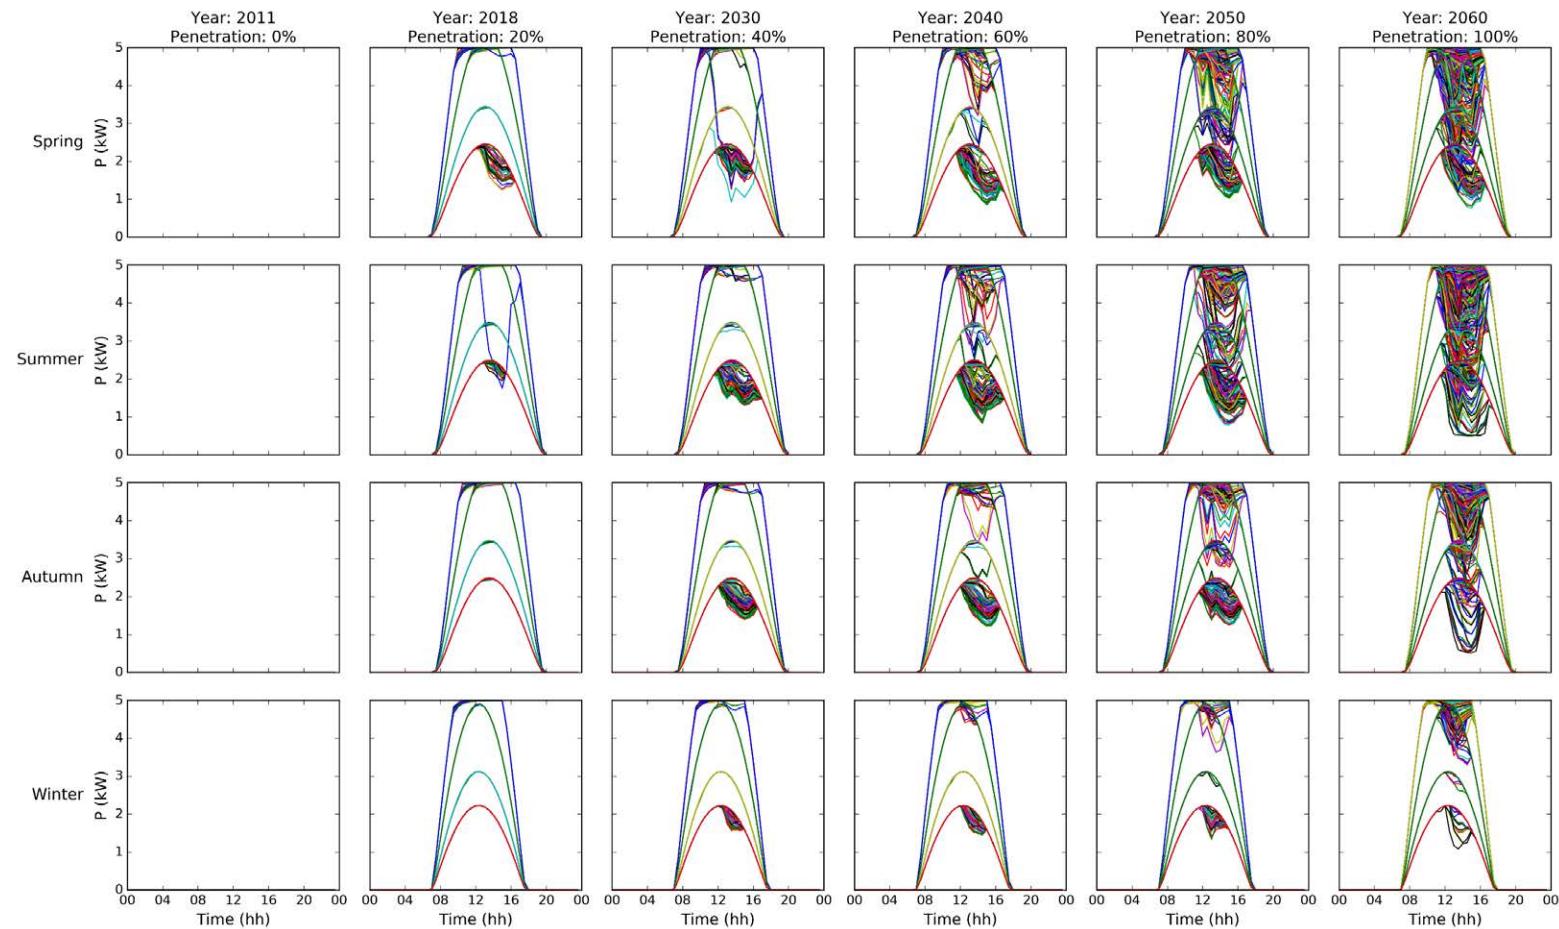


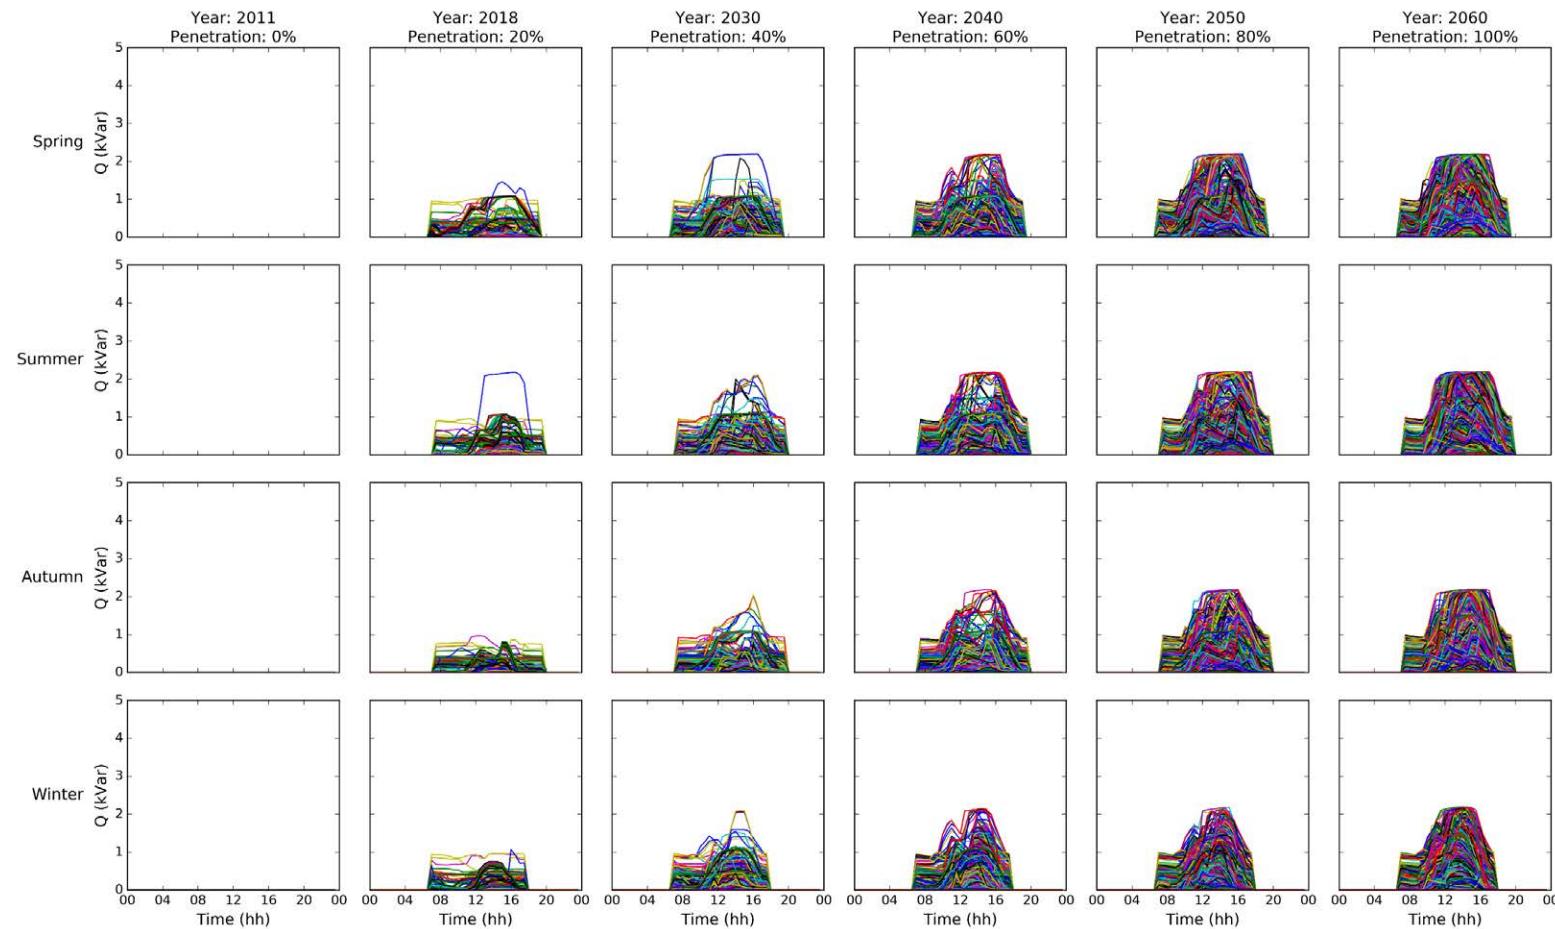


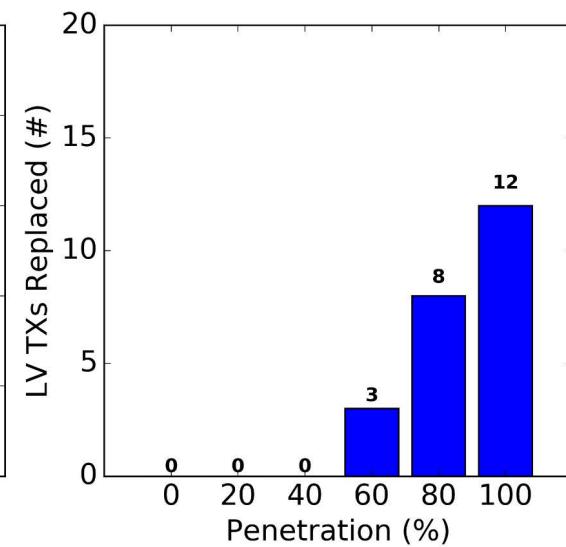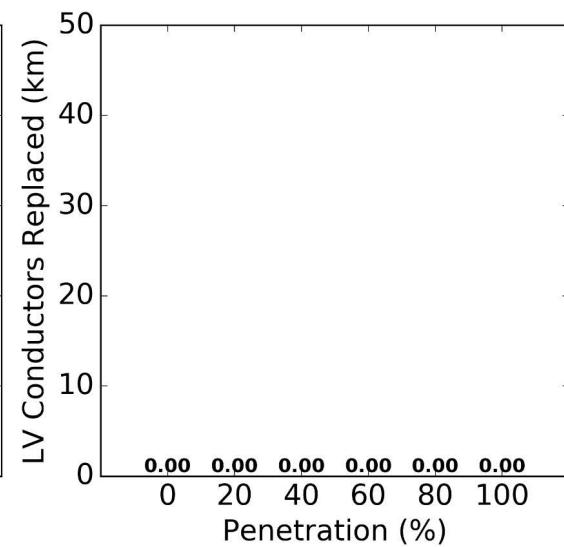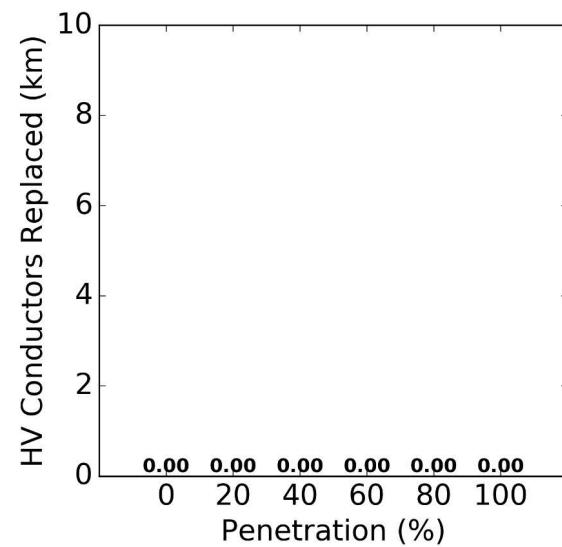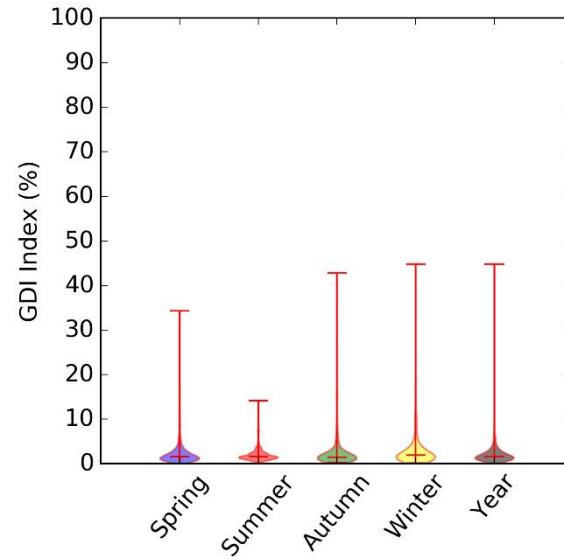



Single Day Analysis – Network Smart BES

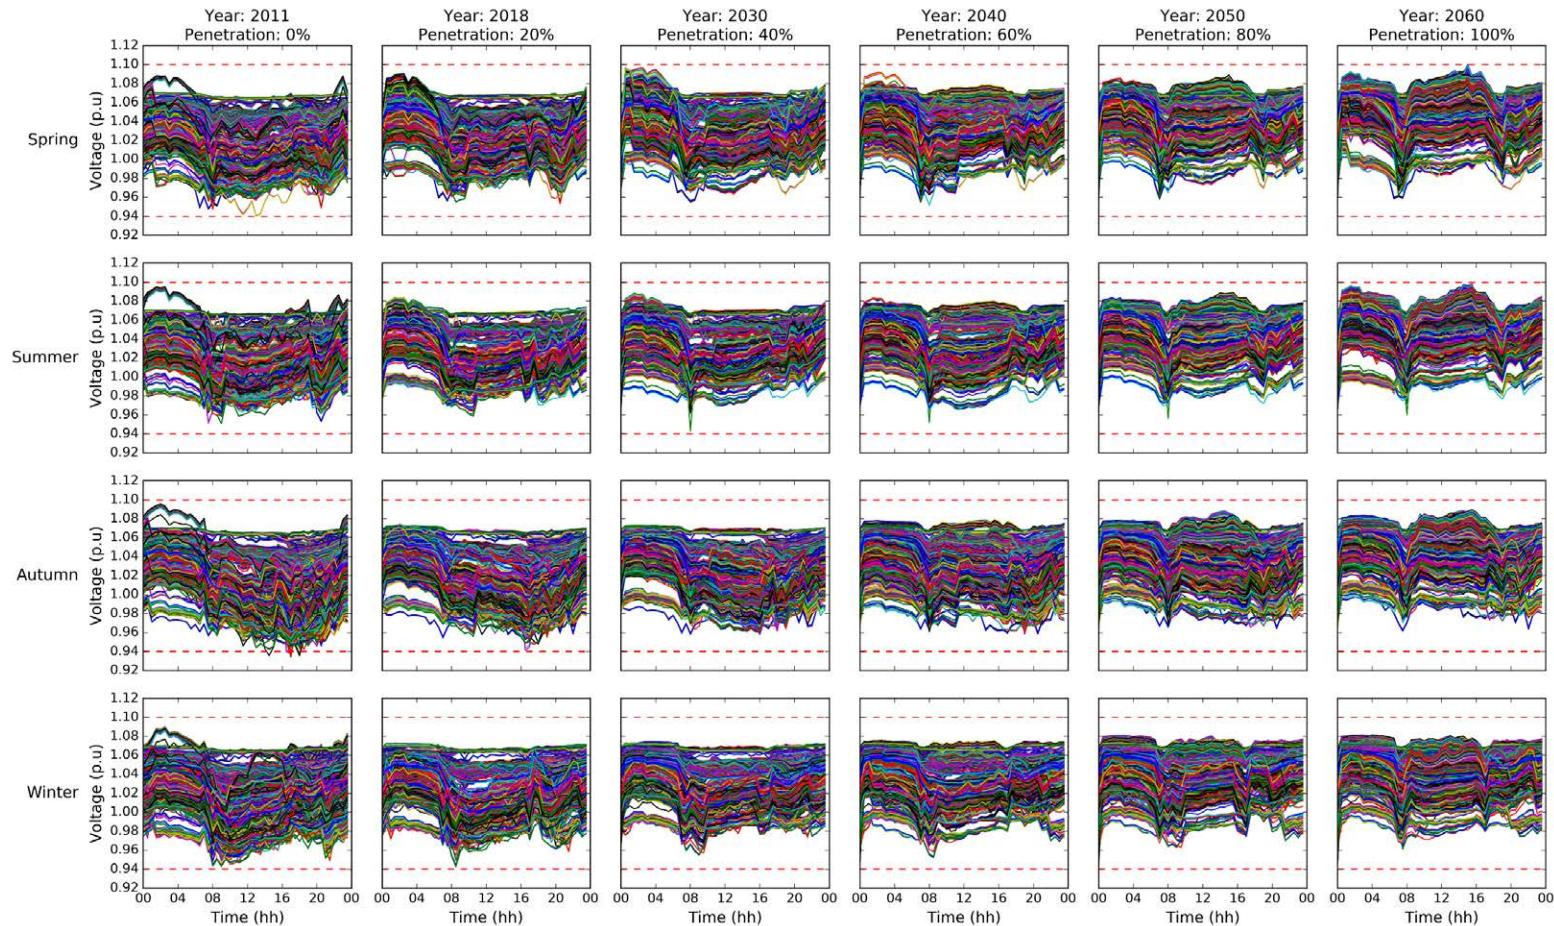


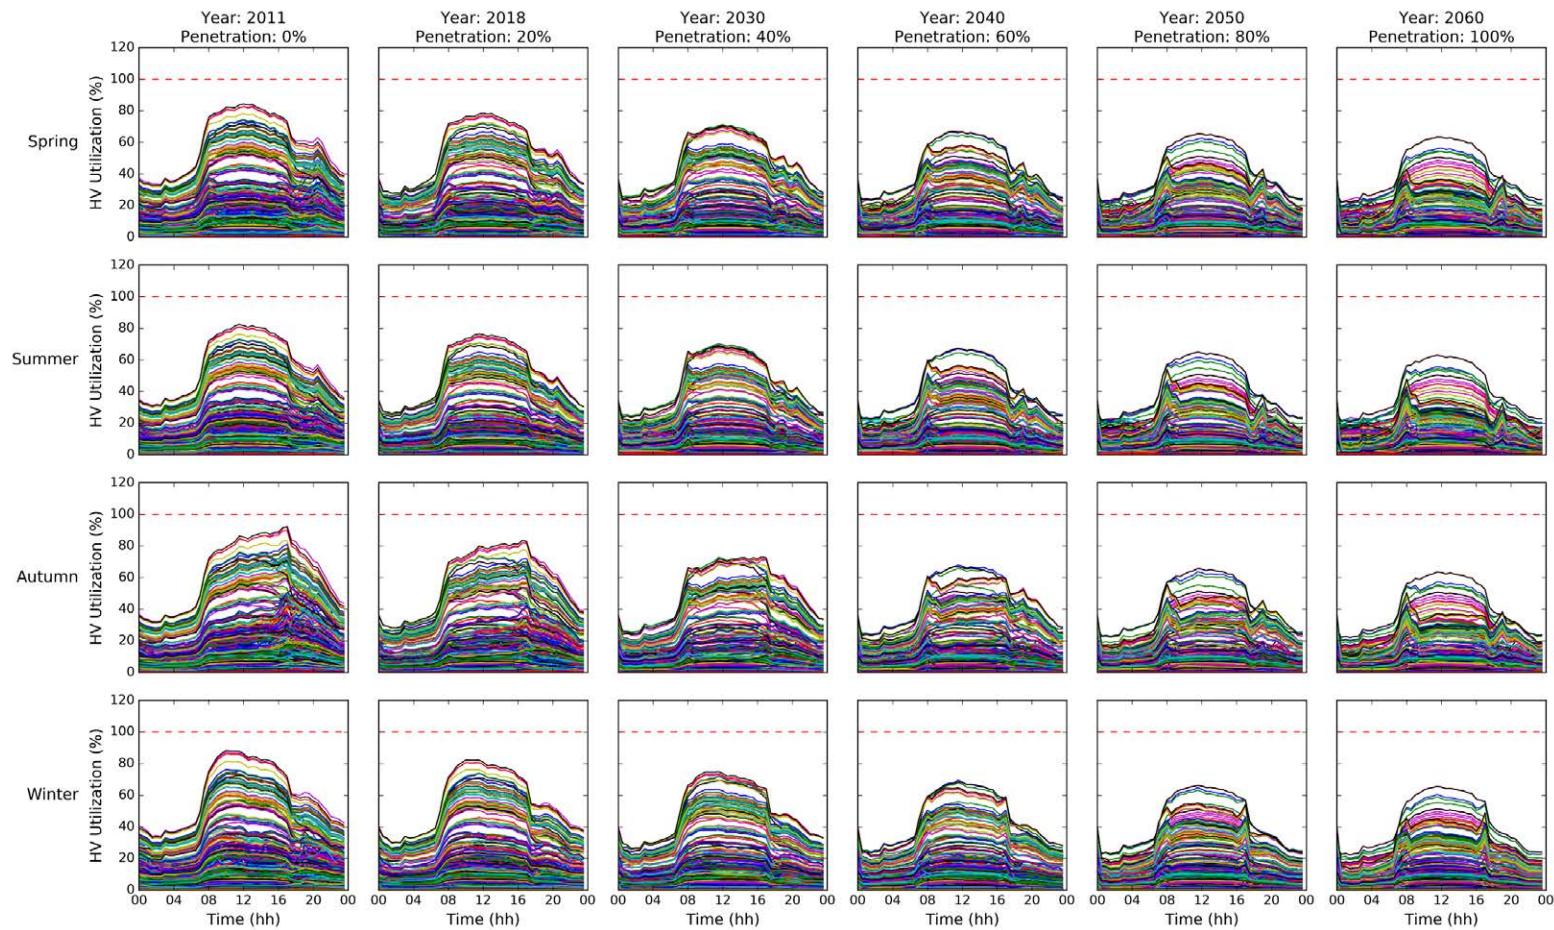


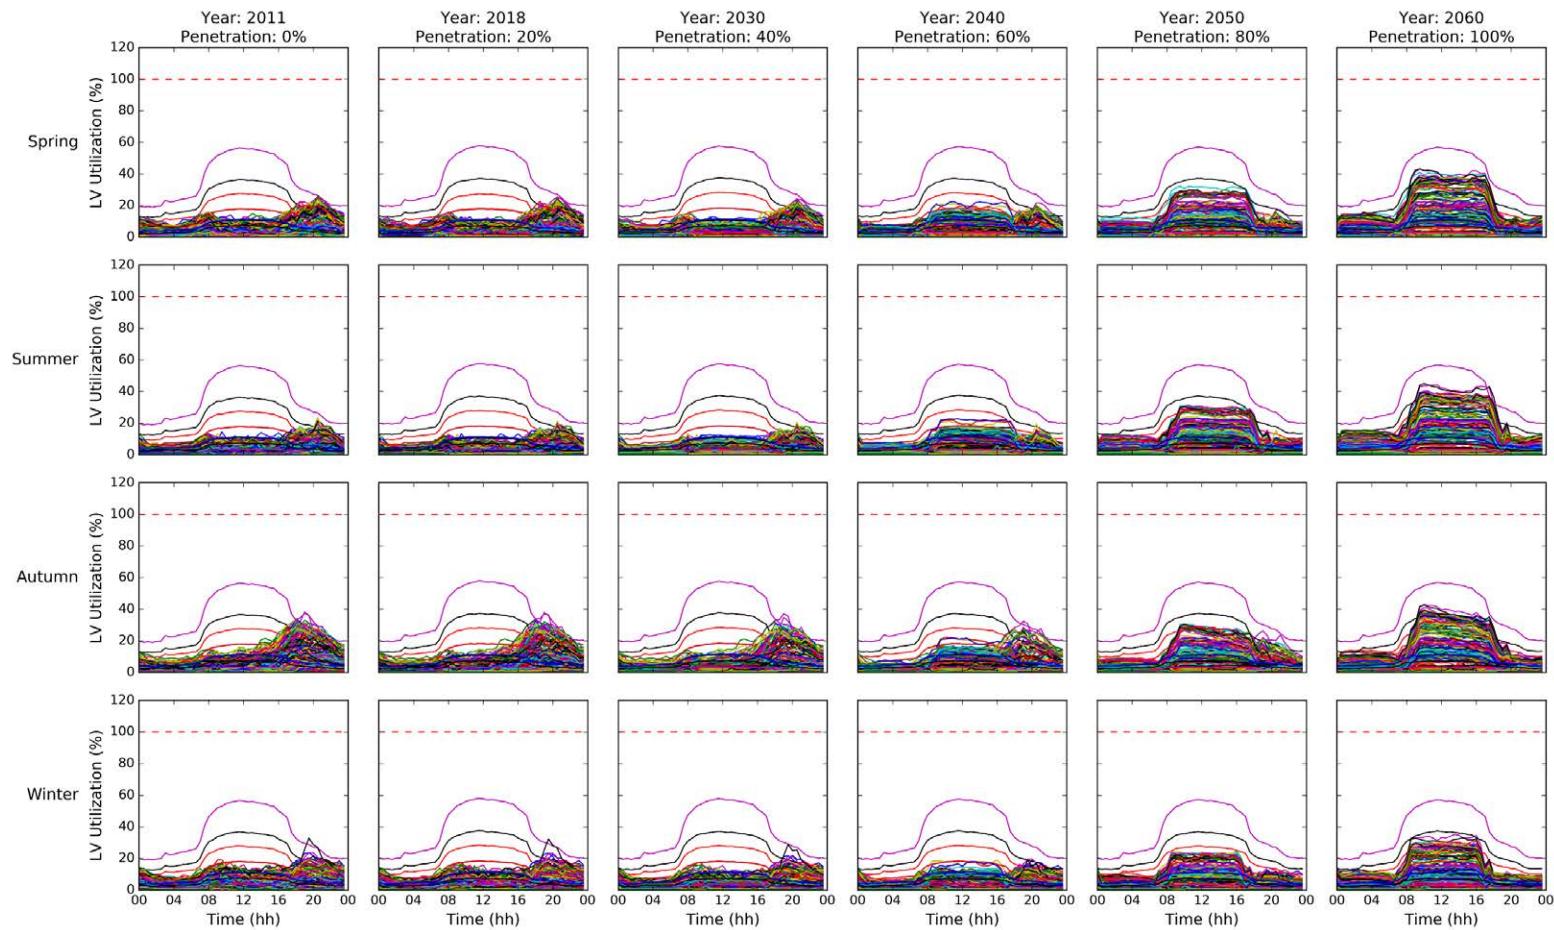

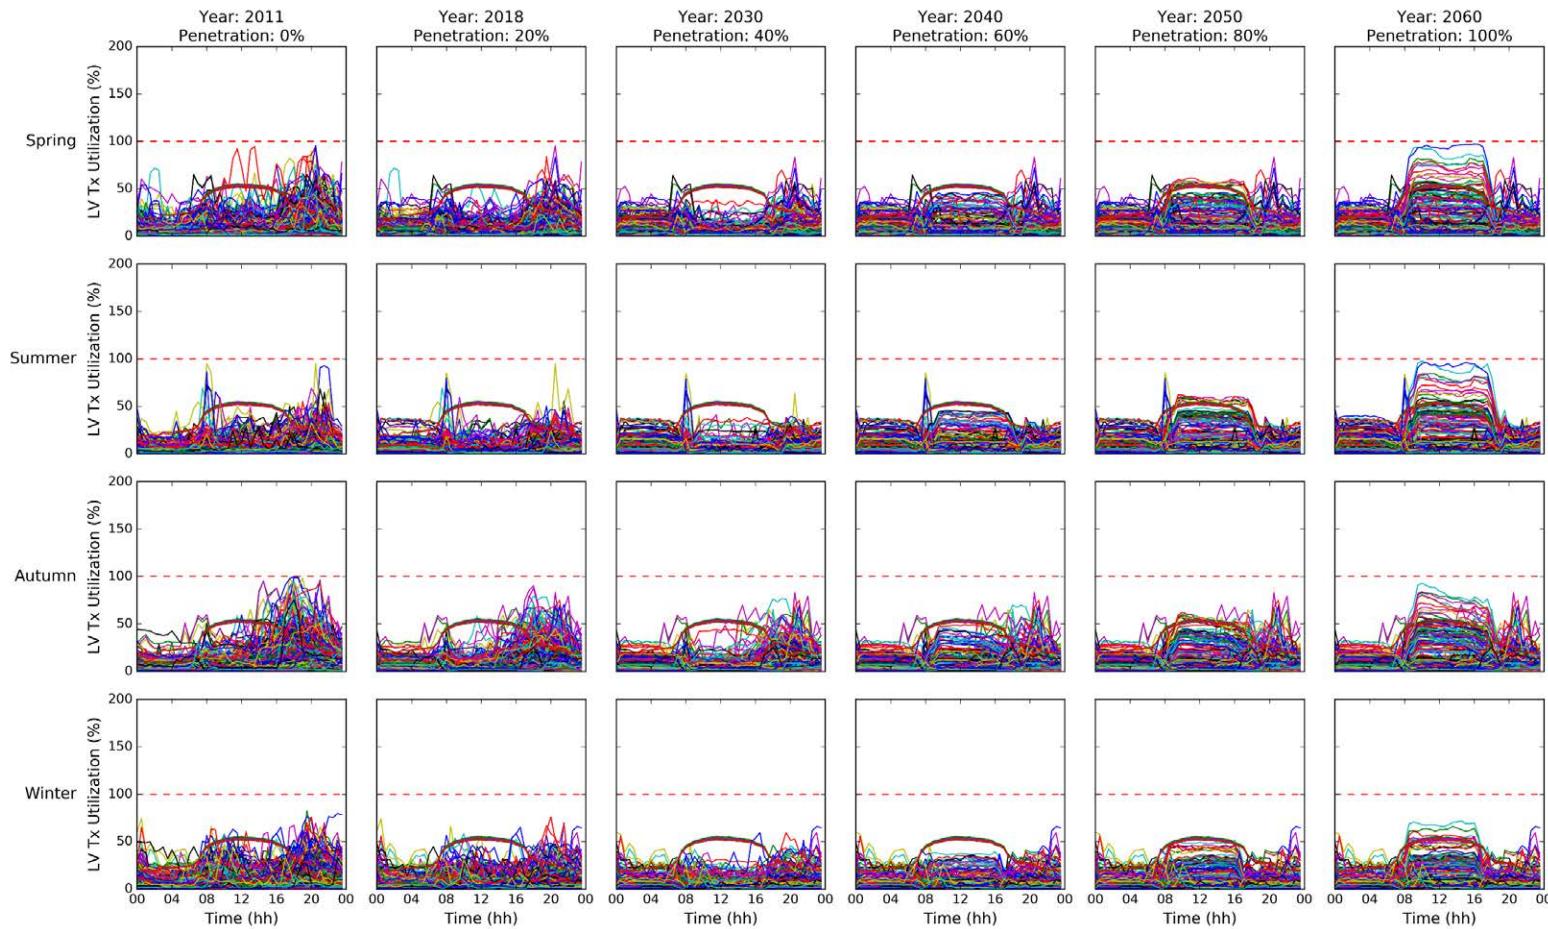


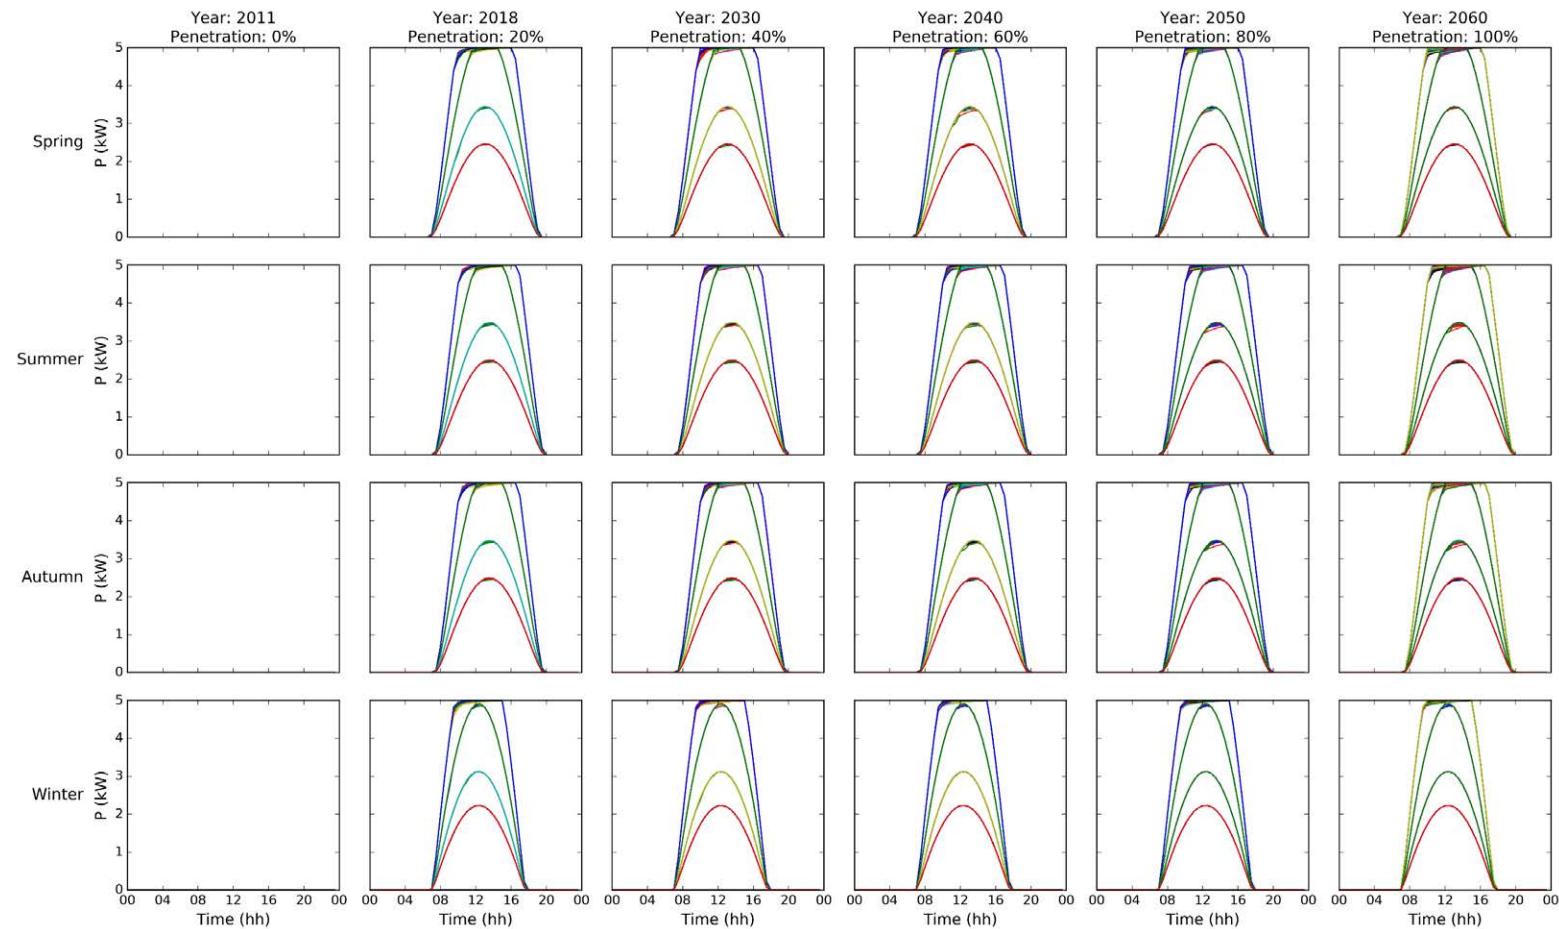


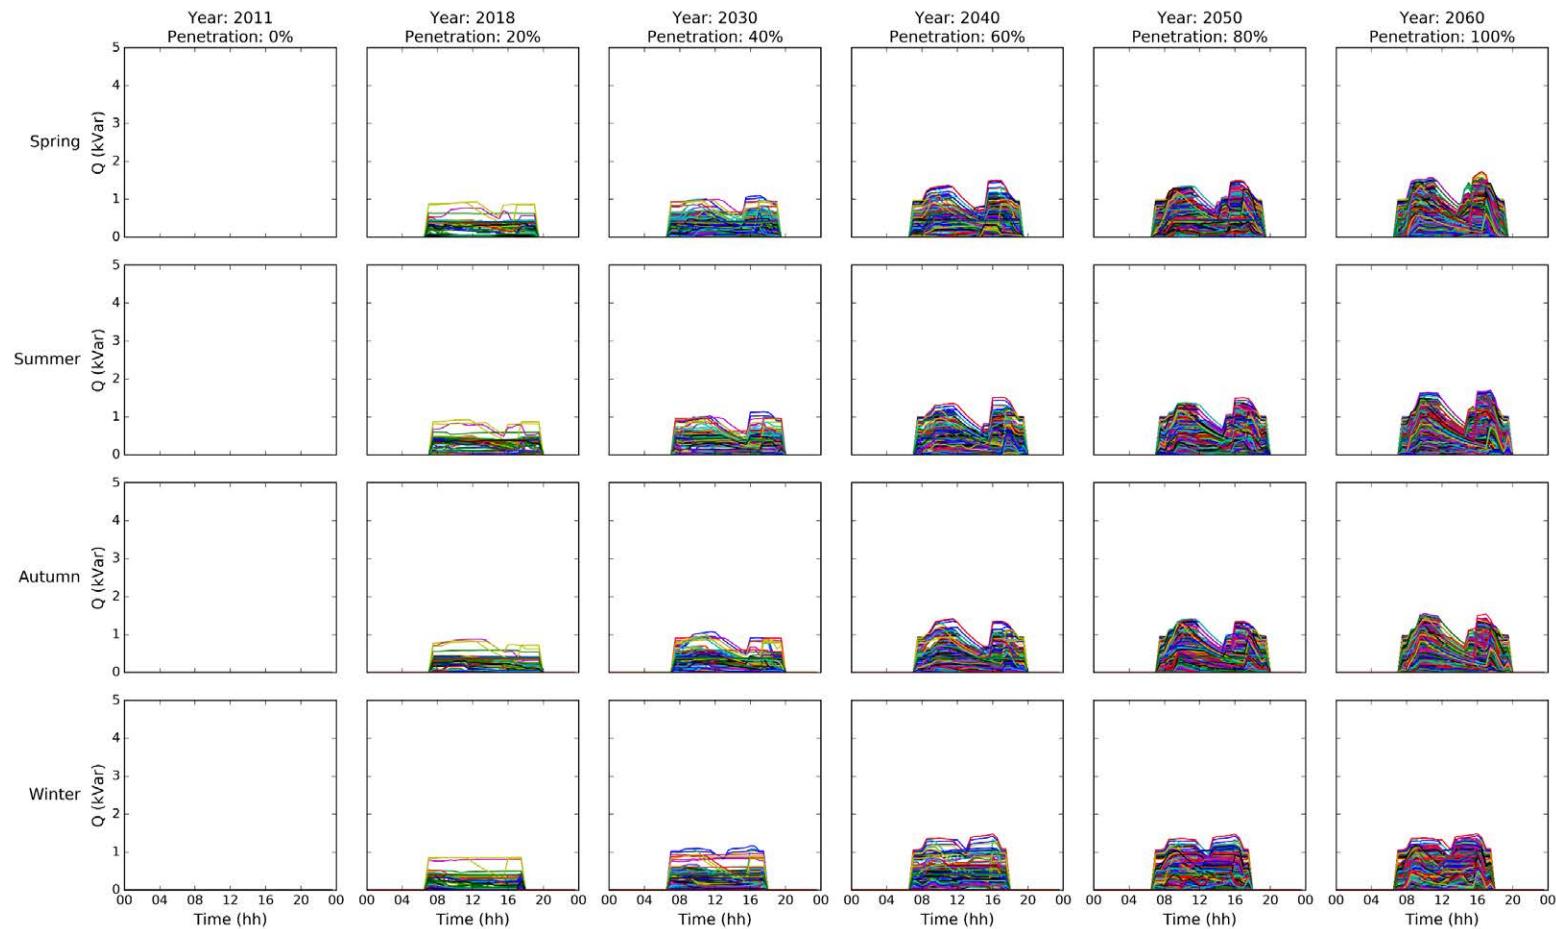

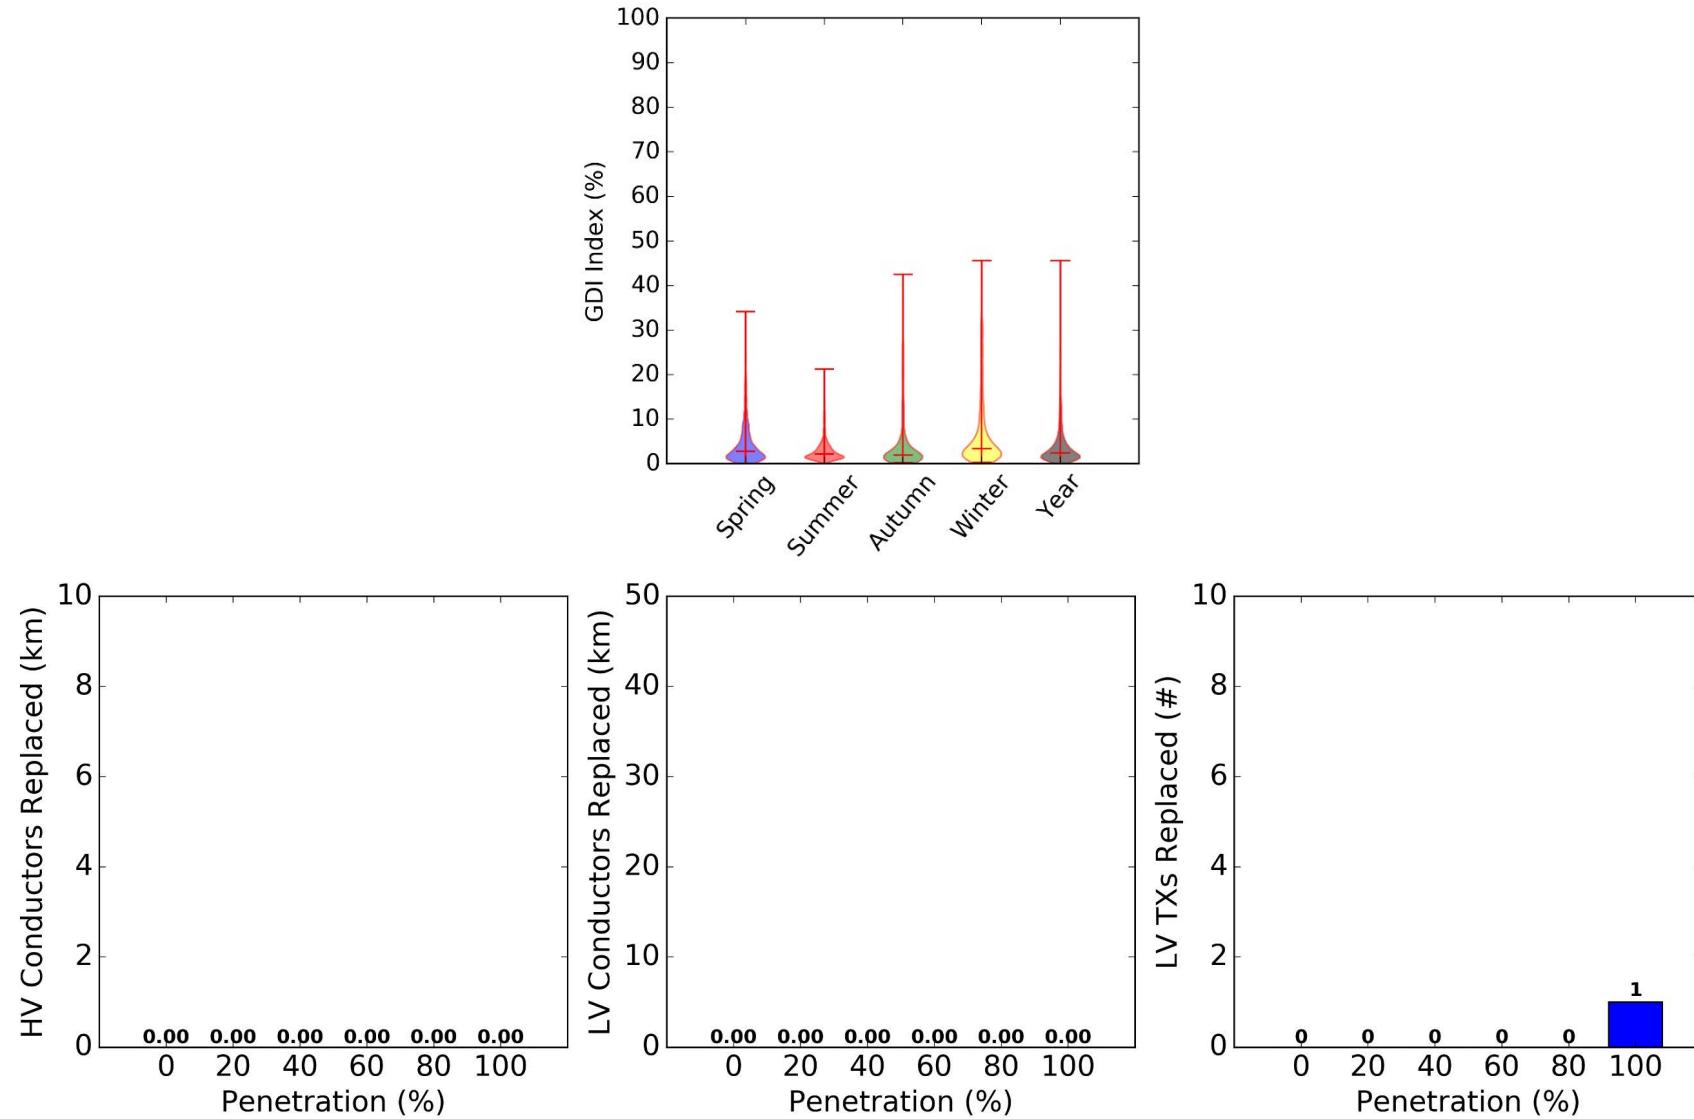



Seasonal Analysis – Tailored Volt-Watt Volt-Var Settings



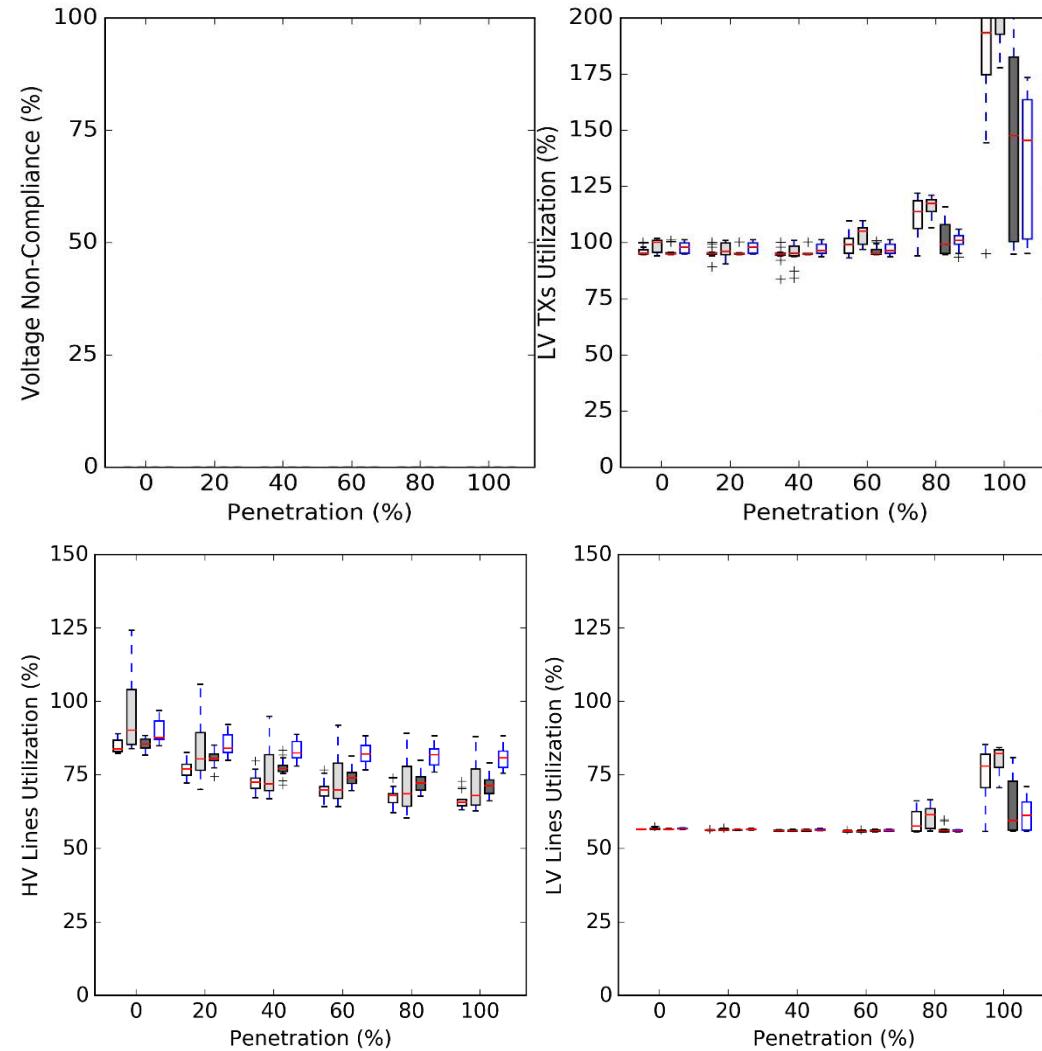


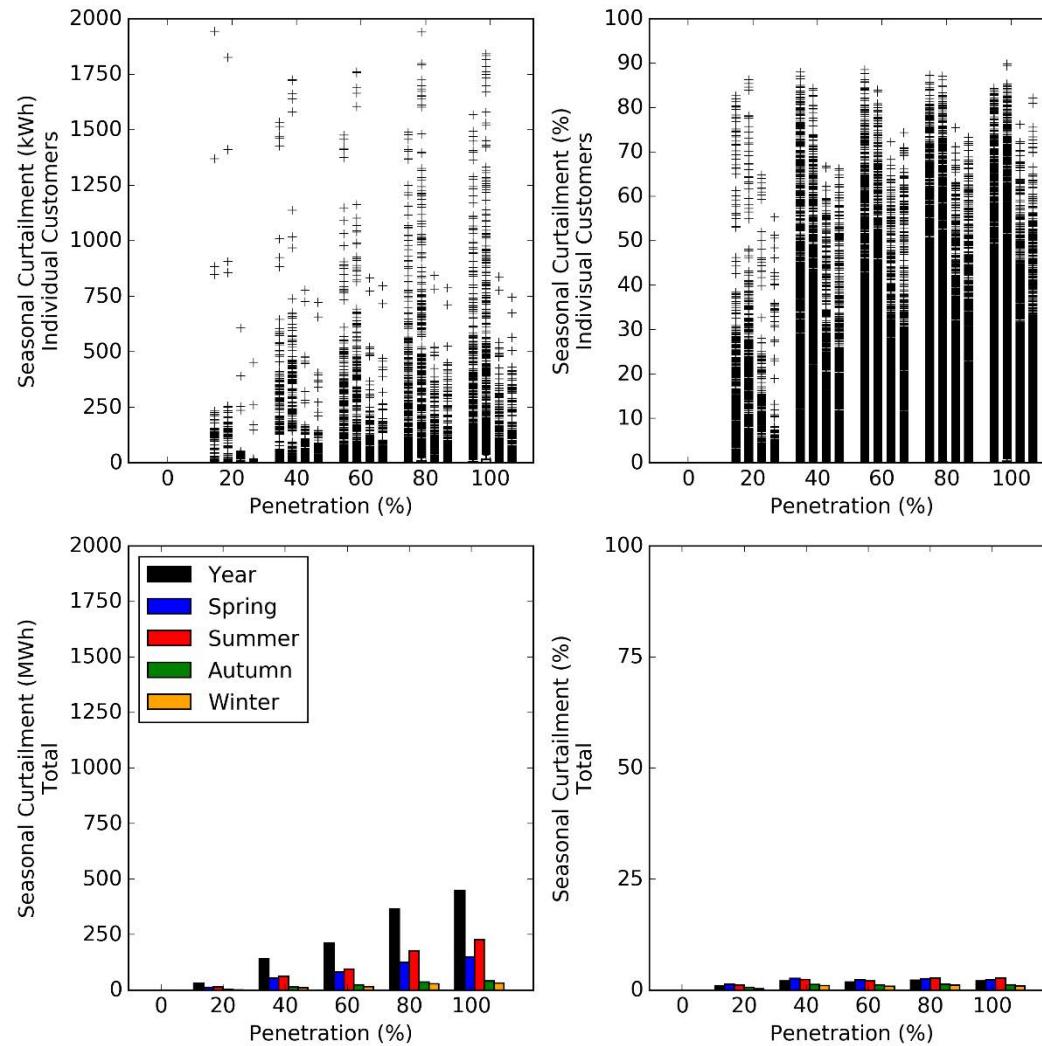


Seasonal Analysis – LV OLTC-fitted Transformers

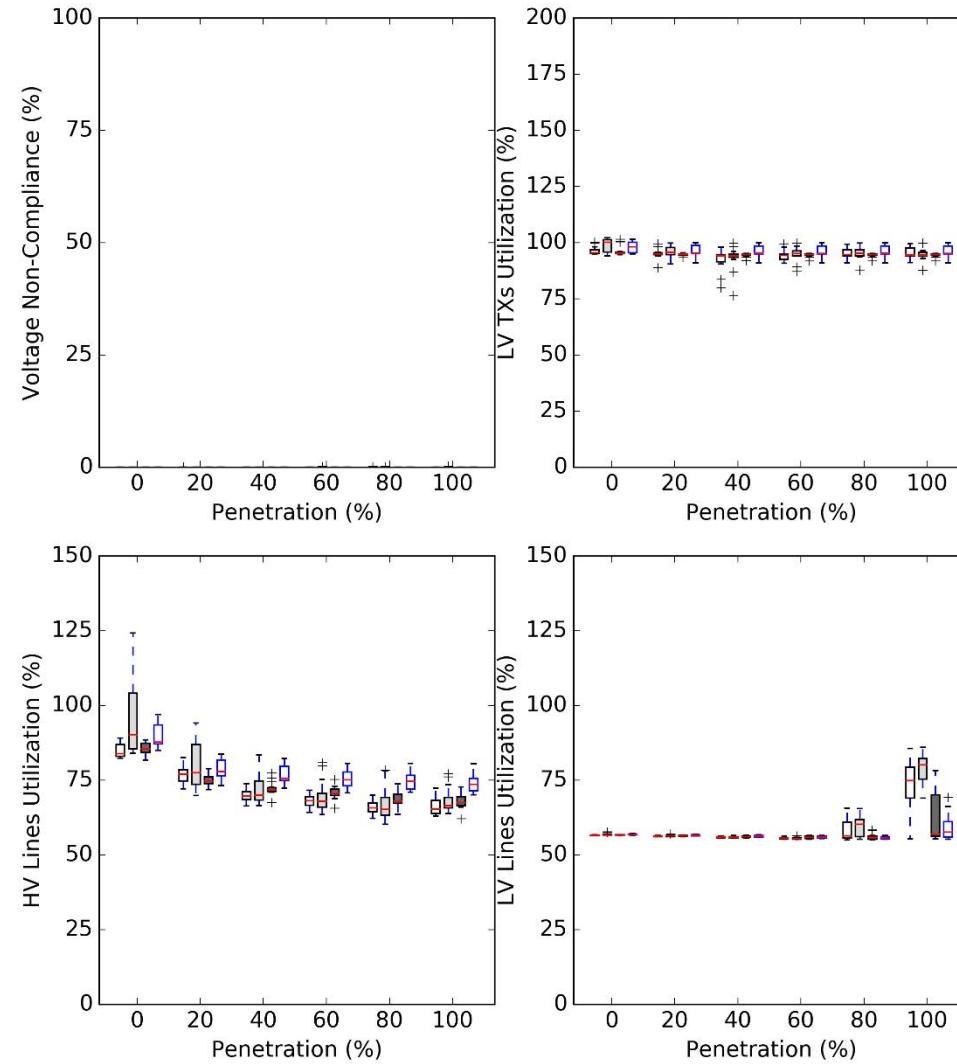


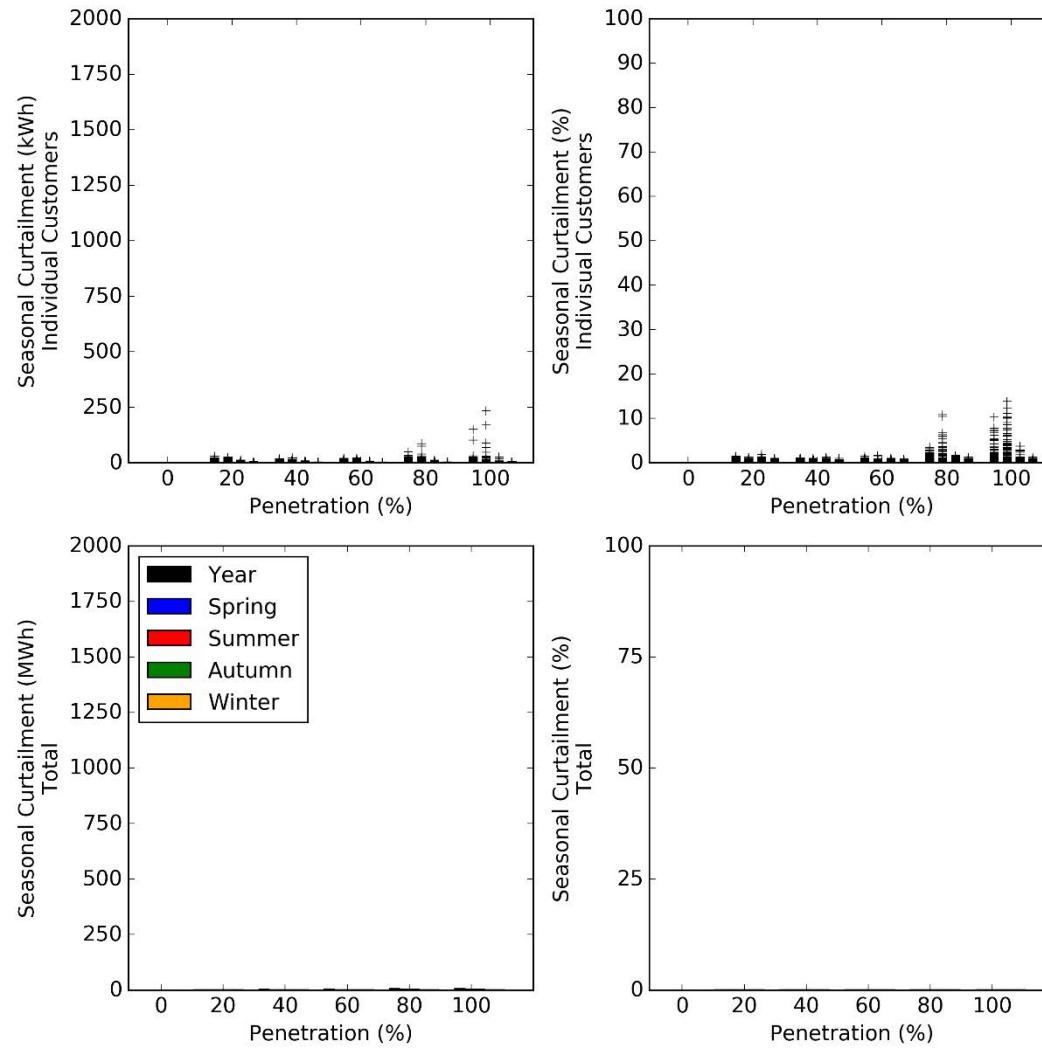


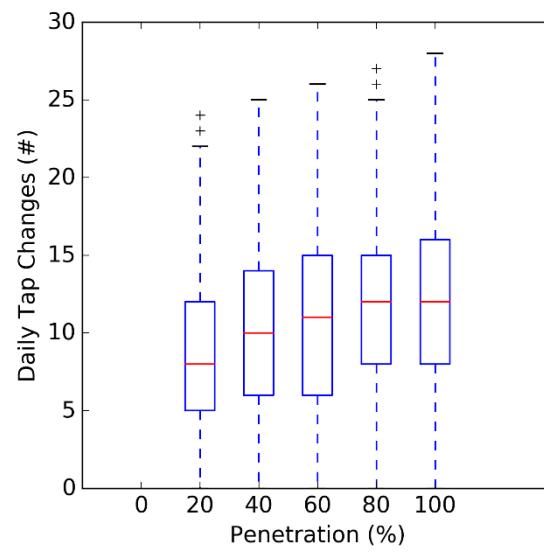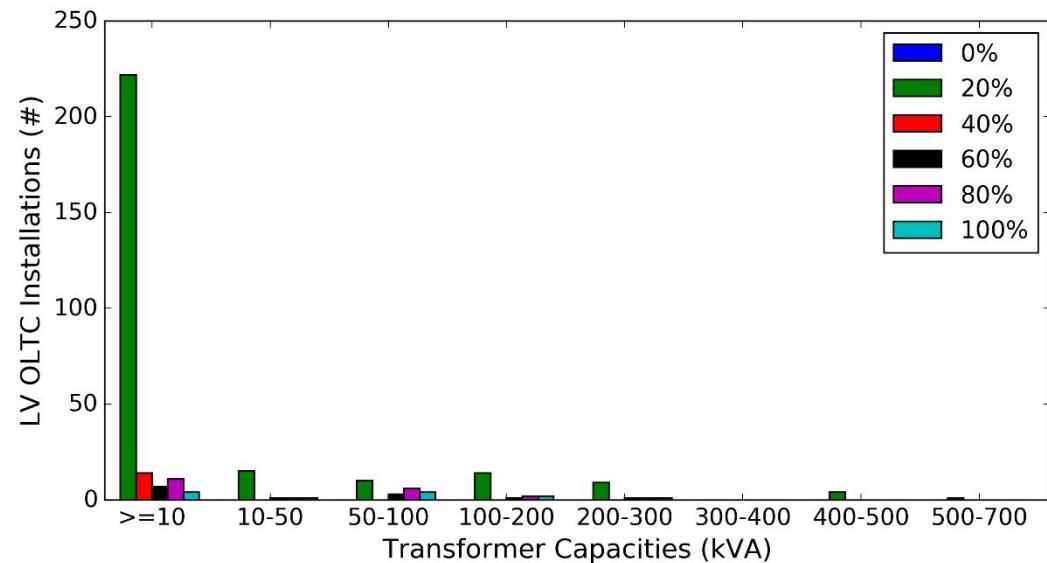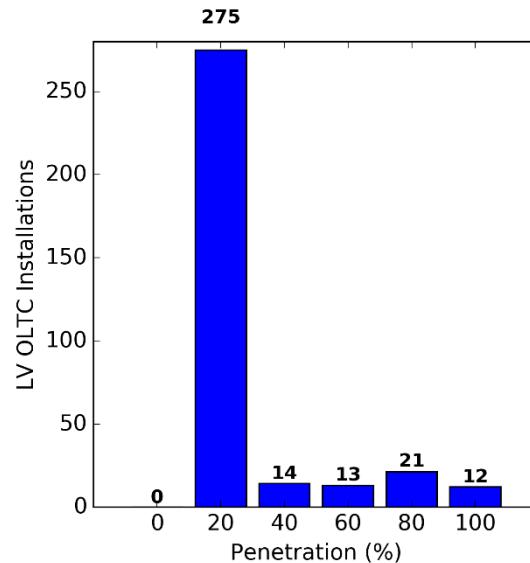


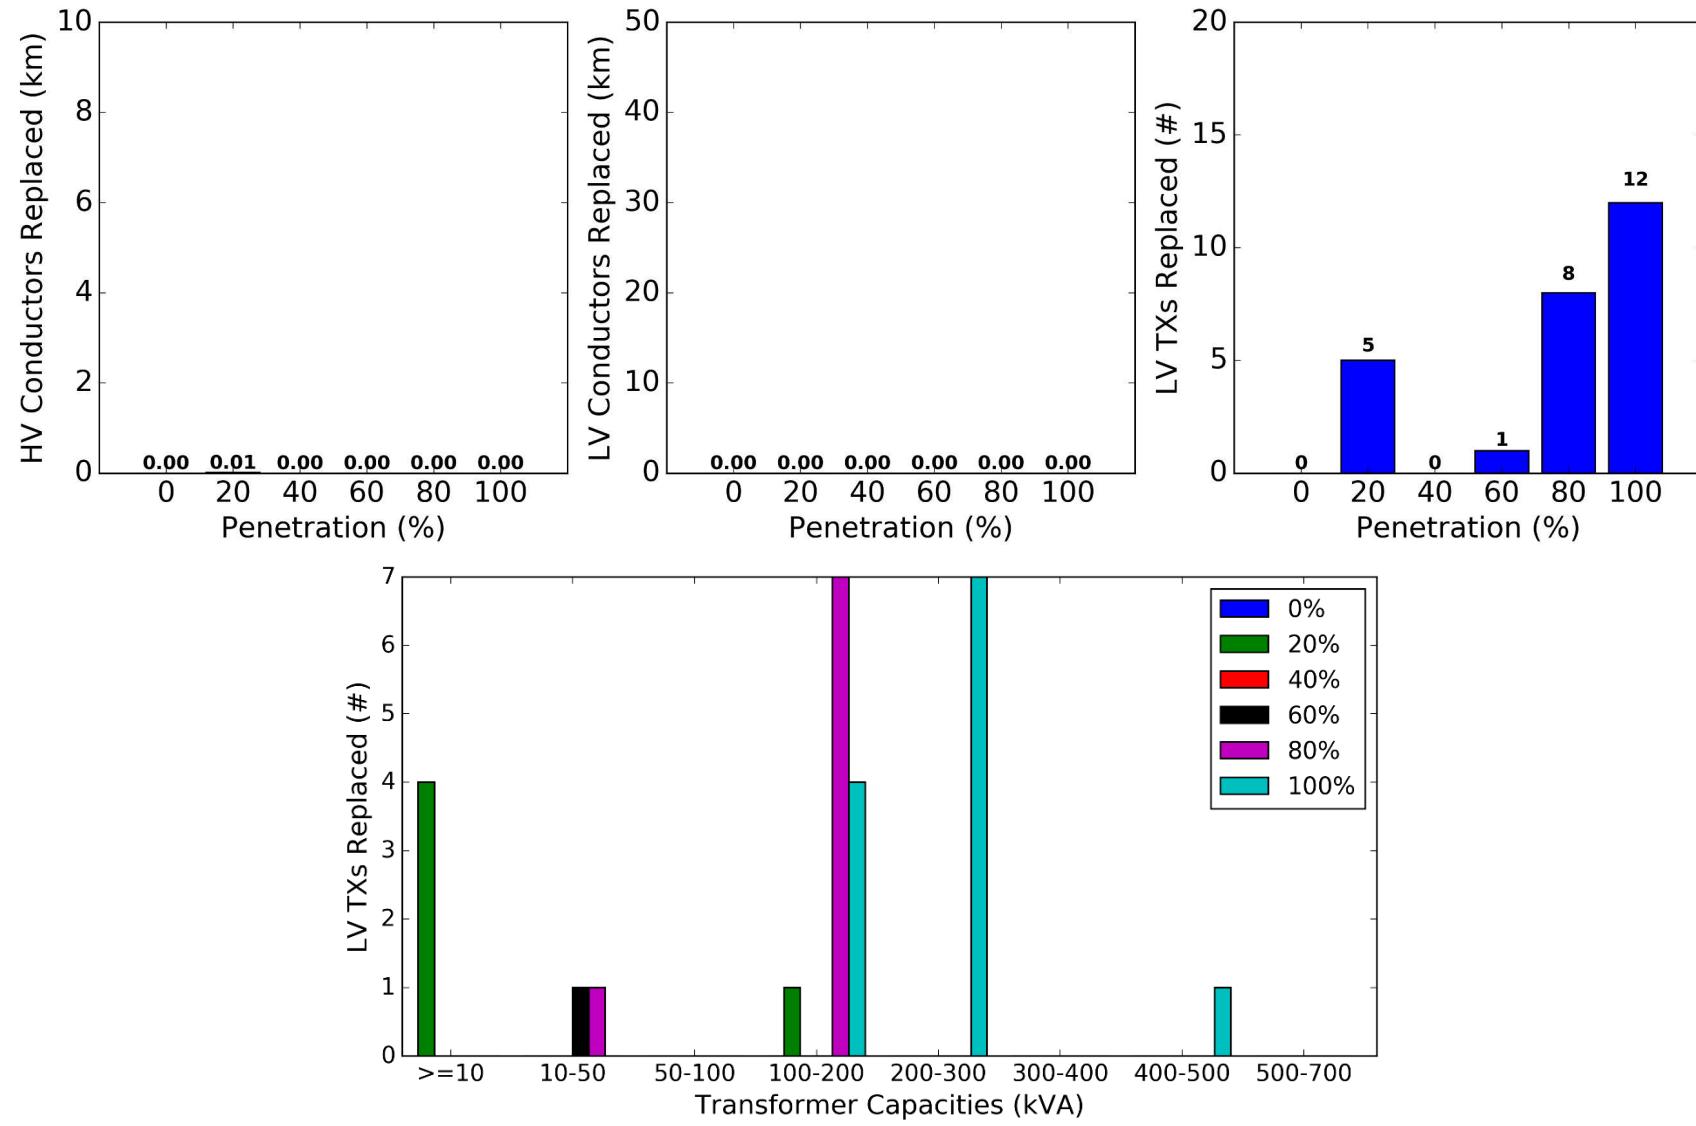

Seasonal Analysis – Off-the-Shelf BES

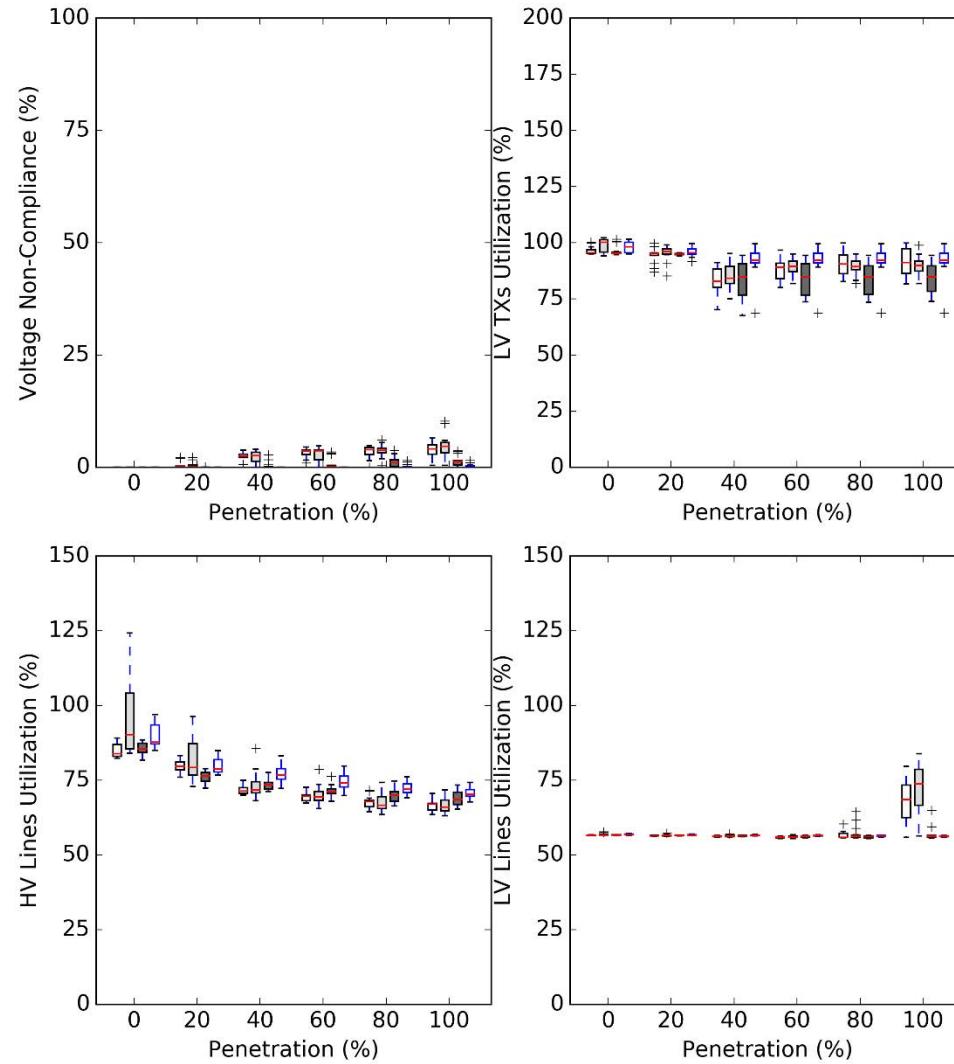

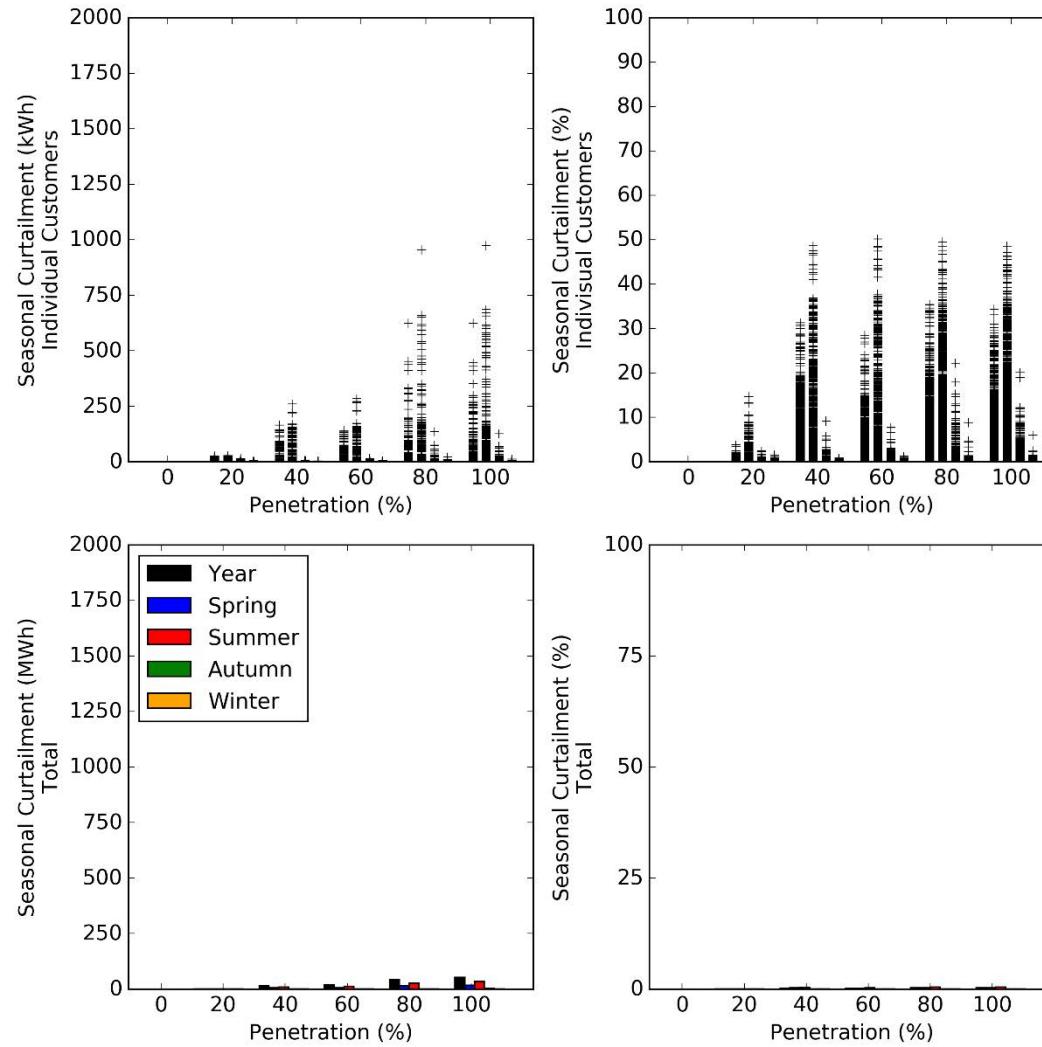

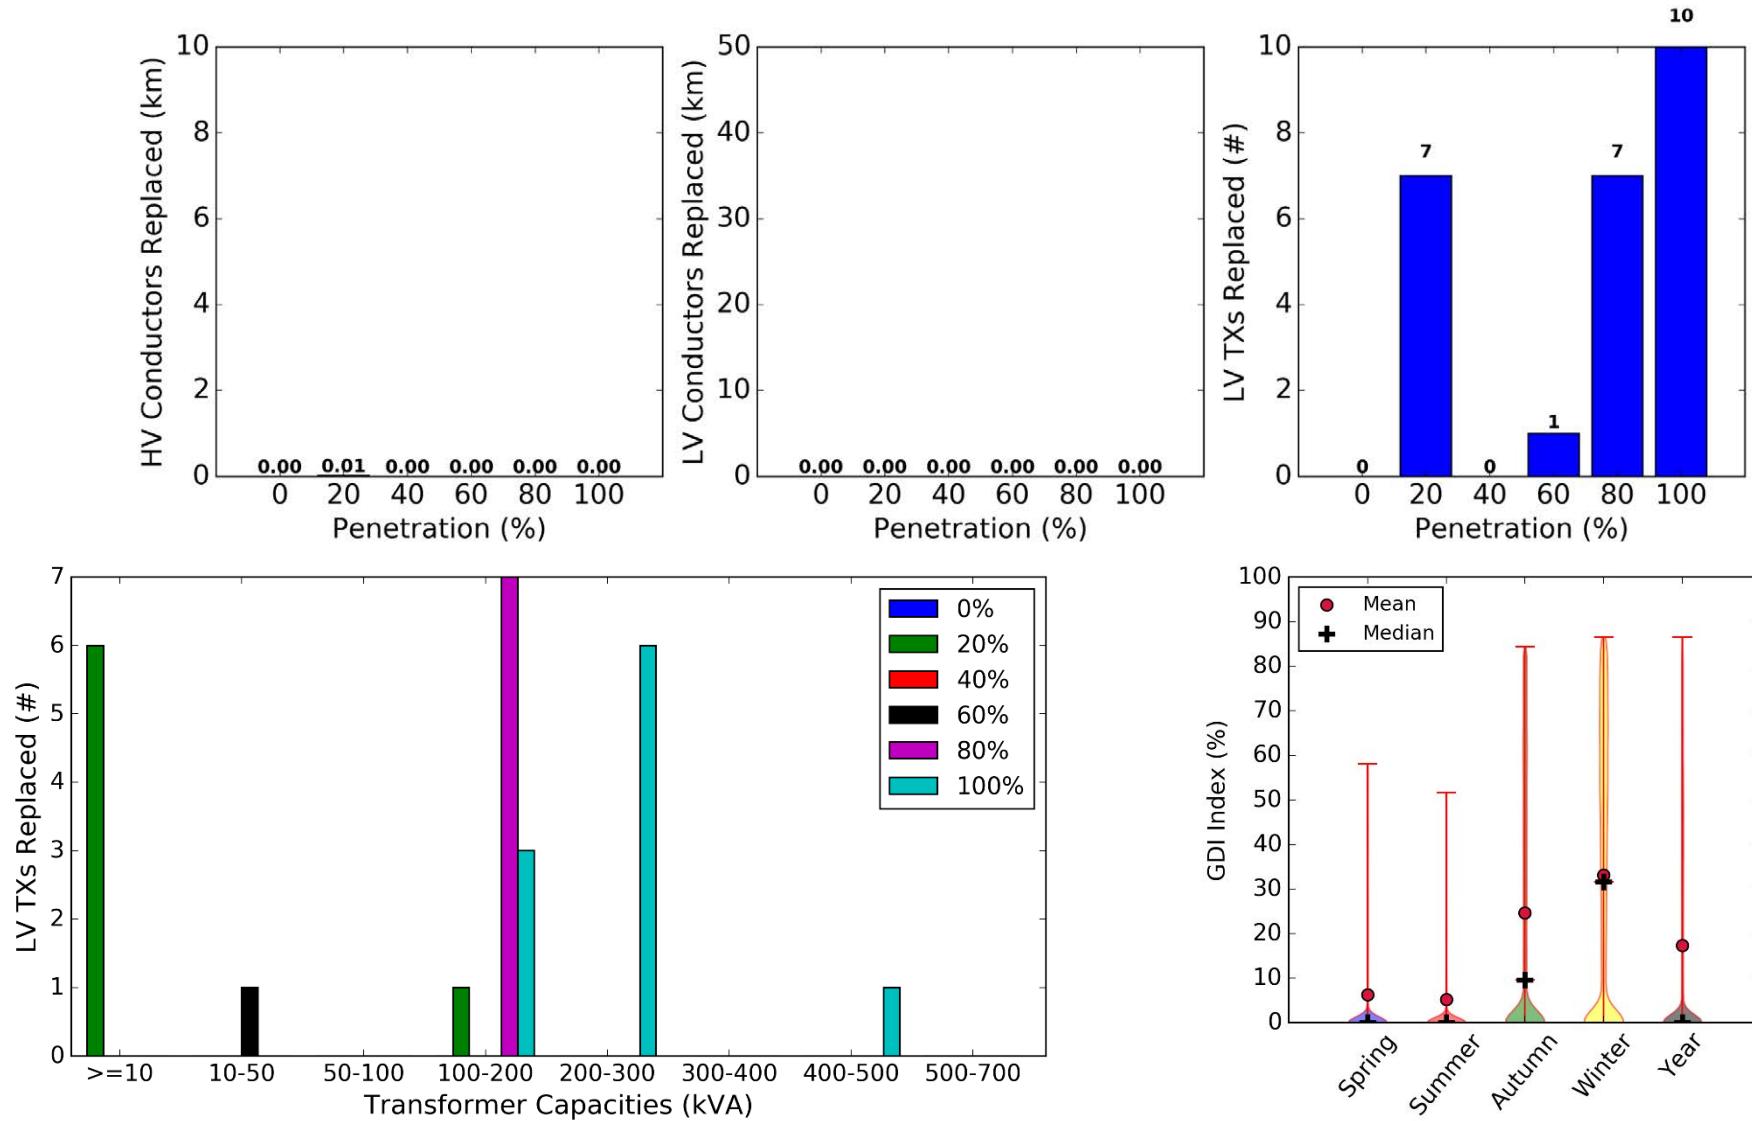

Seasonal Analysis – Network Smart BES

